

**GOVERNMENT OF PUERTO RICO
PUBLIC SERVICE REGULATORY BOARD
PUERTO RICO ENERGY BUREAU**

NEPR

Received:

Jul 3, 2024

9:21 PM

IN RE: REVIEW OF THE PUERTO RICO
ELECTRIC POWER AUTHORITY
INTEGRATED RESOURCE PLAN

CASE NO.: NEPR-AP-2023-0004

SUBJECT: Motion Submitting Responses to
the Fourth Set of IRP Prefiling Period
Requests of Information and Request for
Confidential Treatment

**MOTION SUBMITTING RESPONSES TO THE
FOURTH SET OF IRP PREFILING PERIOD REQUESTS OF INFORMATION AND
REQUEST FOR CONFIDENTIAL TREATMENT**

TO THE HONORABLE PUERTO RICO ENERGY BUREAU:

COME NOW LUMA Energy, LLC (“ManagementCo”), and LUMA Energy ServCo, LLC (“ServCo”), (jointly referred to as “LUMA”), and respectfully state and request the following:

I. Submission of Responses to Fourth RFI and Request for Confidential Treatment

1. On June 18, 2024, the Energy Bureau entered a Resolution and Order in which it instructed LUMA to respond on or before July 5, 2024, to a *Fourth Set of Requests of Information-2024 IRP* set forth in Attachment A to the Resolution and Order (“June 18th Order”). The Energy Bureau determined that LUMA’s responses to the *Third Set of Requests of Information* required clarification. Thus, it required LUMA to respond to the requests for information included in Attachment A of the June 18th Order.

2. In compliance with the June 18th Order, LUMA hereby submits as *Exhibit 1* its responses to the *Fourth Set of Requests of Information- 2024 IRP*. LUMA provides these responses supported by preliminary information. Data, estimates, and other information provided now may change and be revised as LUMA develops the 2024 IRP.

3. Certain responses included in *Exhibit 1* are protected from disclosure under Article 6.15 of Act 57-2014 and Act 80-2011, pursuant to the Bureau's Policy on Management of Confidential Information. *See* Energy Bureau's Policy on Management of Confidential Information, CEPR-MI-2016-0009, issued on August 31, 2016, as amended by Resolution dated September 20, 2016. LUMA hereby requests that certain responses in *Exhibit 1* be maintained confidential. It is submitting a redacted version for public disclosure and an unredacted non-public version under seal of confidentiality. LUMA submits its Memorandum of Law below, stating the legal basis for which the unredacted version of certain responses in *Exhibit 1* should be filed under seal of confidentiality.

II. Memorandum of Law in Support of Request for Confidentiality

A. Applicable Laws and Regulations to submit information confidentially before the Energy Bureau.

4. Section 6.15 of Act 57-2014 regulates the management of confidential information filed before this Energy Bureau. It provides, in pertinent part, that: “[i]f any person who is required to submit information to the Energy [Bureau] believes that the information to be submitted has any confidentiality privilege, such person may request the Commission to treat such information as such” 22 LPRA § 1054n. If the Energy Bureau determines, after appropriate evaluation, that the information should be protected, “it shall grant such protection in a manner that least affects the public interest, transparency, and the rights of the parties involved in the administrative procedure in which the allegedly confidential document is submitted.” *Id.*, Section 6.15 (a).

5. In connection with the duties of electric power service companies, Sections 1.10 (i) and (ix) of Act 17-2019 further provide that electric power service companies shall submit information requested by customers, except for: (i) confidential information in accordance with

the Rules of Evidence of Puerto Rico; [...]; and (vii) trade secrets of third parties. 22 LPRA § 1141i.

6. Access to the confidential information shall be provided “only to the lawyers and external consultants involved in the administrative process after the execution of a confidentiality agreement.” *Id.*, Section 6.15(b), 22 LPRA §1054n. Finally, Act 57-2014 provides that this Energy Bureau “shall keep the documents submitted for its consideration out of public reach only in exceptional cases. In these cases, the information shall be duly safeguarded and delivered exclusively to the personnel of the [Energy Bureau] who needs to know such information under nondisclosure agreements. However, the [Energy Bureau] shall direct that a non-confidential copy be furnished for public review”. *Id.*, Section 6.15(c).

7. The Energy Bureau’s Policy on Confidential Information details the procedures that a party should follow to request that a document or portion thereof, be afforded confidential treatment. In essence, the Energy Bureau’s Policy on Confidential Information requires identification of the confidential information and the filing of a memorandum of law explaining the legal basis and support for a request to file information confidentially. *See* CEPR-MI-2016-0009, Section A, as amended by the Resolution of September 16, 2016, CEPR-MI-2016-0009. The memorandum should also include a table that identifies the confidential information, a summary of the legal basis for the confidential designation, and a summary of the reasons why each claim or designation conforms to the applicable legal basis of confidentiality. *Id.* paragraph 3. The party who seeks confidential treatment of information filed with the Energy Bureau must also file both a “redacted” or “public version” and an “unredacted” or “confidential” version of the document that contains confidential information. *Id.* paragraph 6.

8. The Energy Bureau's Policy on Confidential Information also states the following with regards to access to validated Trade Secret Information:

1. Trade Secret Information

Any document designated by the [Energy Bureau] as Validated Confidential Information because it is a trade secret under Act 80-2011 may only be accessed by the Producing Party and the [Bureau], unless otherwise set forth by the [Bureau] or any competent court.

Id. Section D (on Access to Validated Confidential Information).

9. Relatedly, Energy Bureau Regulation No. 8543, *Regulation on Adjudicative, Notice of Noncompliance, Rate Review, and Investigation Proceedings*, includes a provision for filing confidential information in adjudicatory proceedings before this honorable Bureau. To wit, Section 1.15 provides that, "a person has the duty to disclose information to the [Energy Bureau] considered to be privileged pursuant to the Rules of Evidence, said person shall identify the allegedly privileged information, request the [Energy Bureau] the protection of said information, and provide supportive arguments, in writing, for a claim of information of privileged nature. The [Energy Bureau] shall evaluate the petition and, if it understands [that] the material merits protection, proceed accordingly to . . . Article 6.15 of Act No. 57-2015, as amended."

B. Request to Seal and for Confidential Treatment

10. Under the Industrial and Trade Secret Protection Act of Puerto Rico, Act 80-2011, 10 LPRA §§ 4131-4144, industrial or trade secrets are deemed to be any information:

(a) That has a present or a potential independent financial value or *that provides a business advantage*, insofar as such information is not common knowledge or readily accessible through proper means by persons who could make a monetary profit from the use or disclosure of such information, and

(b) for which reasonable security measures have been taken, as circumstances dictate, to maintain its confidentiality.

Id. § 4132, Section 3 of Act 80-2011. (Emphasis added).

11. Trade secrets include, but are not limited to, processes, methods and mechanisms, manufacturing processes, formulas, projects, or patterns to develop machinery and lists of specialized clients that may afford an advantage to a competitor. *See* Statement of Motives, Act 80-2011. As explained in the Statement of Motives of Act 80-2011, protected trade secrets include any information bearing commercial or industrial value that the owner reasonably protects from disclosure. *Id.* *See also* Article 4 of Puerto Rico’s Open Data Law, Act 122-2019 (exempting the following from public disclosure: (1) commercial or financial information whose disclosure will cause competitive harm; (2) trade secrets protected by a contract, statute, or judicial decision (3) private information of third parties). *See* Act 122-2019, Articles 4 (ix) and (x) and (xi)), 3 LPRA § 9894.

12. The Puerto Rico Supreme Court has explained that the trade secrets privilege protects free enterprise and extends to commercial information that is confidential in nature. *Ponce Adv. Med. v. Santiago Gonzalez*, 197 DPR 891, 901-02 (2017) (citation omitted); *see also Next Step Medical Co. v. MCS Advantage Inc.*, KLCE201601116, 2016 WL 6520173 (P.R. Court of Appeals, September 13, 2016) (holding that in Puerto Rico, what constitutes trade secrets is evaluated applying a broad definition). A trade secret includes ***any and all information*** (i) from which a real or potential value or economic advantage may be derived; (ii) that is not common knowledge or accessible through other means; and (iii) as to which reasonable security measures have been adopted to keep the information confidential. *Ponce Adv. Medical*, 197 DPR at 906.

13. Table 1, a part of RFI-LUMA-AP-2023.0004-20240618-PREB-002a, includes information on Tranche 2 resources that are a part of the procurement process currently conducted by this Energy Bureau. The information on proponents and expected capacities should be removed

from the public record until the procurements conclude to protect the fairness and purity of bidding processes. LUMA understands that said information has not been made otherwise public and, thus, should be removed from the public filing of RFI-LUMA-AP-2023.0004-20240618-PREB-002a.

14. This honorable Energy Bureau has maintained under seal the documents, including confidential information related to the Tranche 1 Request for Proposals (“Tranche 1 RFP”) process. To that end, through its Resolution and Order of February 2, 2022 (“February 2nd Order”) in Case No. NEPR-MI-2020-0012, *In Re: Implementation of the Puerto Rico Electric Power Authority Integrated Resource Plan and Modified Action Plan* (“IRP Implementation Docket”), this honorable Energy Bureau established that such confidential treatment is required pursuant to Sections 4.8(g) and 10.2 of the Joint Regulations for the Procurement, Evaluation, Selection, Negotiation, and Award of Contracts for the Purchase of Energy and for the Procurement, Evaluation, Selection, Negotiation and Award Process for the Modernization of the Generation Fleet, Regulation 8815 of October 11, 2016 (“Regulation 8815”). *See* the February 2nd Order in footnote 28. *See also* Energy Bureau Resolution and Order of June 13, 2022 in the IRP Implementation Docket on page 10 (wherein the Energy Bureau determined that certain documents submitted by LUMA and PREPA “containing detailed information related to ongoing negotiations, strategies to prepare documents to be negotiated and proposals in the tranche RFP process” were confidential until the adjudication and award process is final). This request to seal is in alignment with the aforementioned prior rulings by this Energy Bureau to protect and maintain the purity of the procurement process and avoid disclosure of information that may affect the financial, competitive, or bargaining position of the parties. *See* Regulation 8815, Section 4.8(g).

15. Secondly, Table 2, found in RFI-LUMA-AP-2023.0004-20240618-PREB-002b, includes information that LUMA received confidentially from Genera PR, LLC (“Genera”). Genera has informed LUMA that it treats that information confidentially as it involves proposed

generation resources that are a part of active procurement processes. The information should be removed from the public record until the procurement concludes to protect the fairness and purity of bidding processes. Said information has not been made otherwise public and thus, should be received and kept under seal of confidentiality.

16. Thirdly, one of the attachments submitted in response to RFI-LUMA-AP-2023.0004-20240618-PREB-003a may be subject to copyright. To wit, the article titled *Electricity consumption changes following solar adoption: Testing for a solar rebound*, by Ross C. Beppler, Daniel C. Matisoff, and Matthew W. Oliver (2021), is subject to ResearchGate's Intellectual Property Policy¹, which does not contemplate the use and reproduction of its content. Therefore, LUMA treats this document as confidential, considering it is proprietary information belonging to a third party.

17. The information included in Table 1 of RFI-LUMA-AP-2023.0004-20240618-PREB-002a, Table 2 of RFI-LUMA-AP-2023.0004-20240618-PREB-002b and the attachment to response RFI-LUMA-AP-2023.0004-20240618-PREB-003a: article *Electricity consumption changes following solar adoption: Testing for a solar rebound*, should be considered Confidential by this Energy Bureau pursuant to Section 6.15 of Law 57-2014 and, therefore, treated as confidential per the Policy on Confidential Information.

18. The table below identifies the information that LUMA requests should be received and kept under seal of confidentiality and the grounds for the request for confidential treatment:

¹<https://www.researchgate.net/ip-policy?tp=eyJjb250ZXh0Ijp7ImZpcnN0UGFnZSI6InB1YmxpY2F0aW9uIiwicGFnZSI6InB1YmxpY2F0aW9uIn19>

Identification of Confidential Information	Summary of Legal Basis for Confidentiality Protection	Date Filed
LUMA’s Response to Fourth Pre-Filing Period RFI, Table 1 RFI-LUMA-AP-2023.0004-20240618-PREB-002a	Sensitive Commercial Information and Trade Secrets under Act 80-2011 and pursuant to Energy Bureau Regulation 8815	July 3, 2024
LUMA’s Response to Fourth Pre-Filing Period RFI, Table 2 RFI-LUMA-AP-2023.0004-20240618-PREB-002b	Sensitive Commercial Information and Trade Secrets under Act 80-2011 and pursuant to Energy Bureau Regulation 8815	July 3, 2024
LUMA’s Response to Fourth Pre-Filing Period RFI, RFI-LUMA-AP-2023.0004-20240618-PREB-003a Ross C. Beppler, Daniel C. Matisoff, and Matthew W. Oliver (2021) <i>Electricity consumption changes following solar adoption: Testing for a solar rebound</i>	Sensitive Commercial Information and Trade Secrets of third parties protected from disclosure under Act 17-2019 and Act 80-2011; Proprietary Information	July 3, 2024

WHEREFORE, LUMA respectfully requests the Energy Bureau to **take notice** of the foregoing, **deem** that LUMA complied with the Resolution and Order dated June 18, 2024 and **grant** LUMA's request for confidential treatment as stated herein.

RESPECTFULLY SUBMITTED.

I HEREBY CERTIFY that this Motion was filed using the electronic filing system of this Energy Bureau and that electronic copies of this Motion will be notified to the Puerto Rico Electric Power Authority: lionel.santa@prepa.pr.gov and through its attorneys of record González & Martínez, Mirelis Valle-Cancel, mvalle@gmlex.net; and Alexis G. Rivera Medina, arivera@gmlex.net; and Genera PR, LLC: brannen@genera-services.com; kbolanos@genera-pr.com; regulatory@genera-pr.com.

RESPECTFULLY SUBMITTED.

In San Juan, Puerto Rico, on July 3, 2024.



DLA Piper (Puerto Rico) LLC
Calle de la Tanca #500, Suite 401
San Juan, PR 00901-1969
Tel. 787.945.9132
Fax 939.697.6102

/s/ Margarita Mercado Echegaray
Margarita Mercado Echegaray
RUA NÚM. 16,266
margarita.mercado@us.dlapiper.com

/s/ Yahaira De la Rosa Algarín
Yahaira De la Rosa Algarín
PR Bar No. 18,061
yahaira.delarosa@us.dlapiper.com

Exhibit 1



2024 Integrated Resource Plan (2024 IRP)

NEPR-AP-2023-0004

Responses to June 18, 2024

2024 INTEGRATED RESOURCE PLAN

PREFILING PROCESS OF THE 2024 INTEGRATED RESOURCE PLAN (2024 IRP)

NEPR-AP-2023-0004

RESPONSE: RFI-LUMA-AP-2023.0004-20240618-PREB-001-04

The Energy Bureau issued on June 18, 2024, a Resolution and Order (June 18th R&O) ordering LUMA to submit responses to the Fourth 2024 Integrated Resource Plan (2024 IRP) Prefiling Requests of Information (RFI). LUMA hereby complies and submits its response to Attachment A of the June 18th R&O addressing questions on:

- PLEXOS® modeling parameters
- Loss of Load Expectation (LOLE)/ Loss of Load Probability (LOLP) target
- Rebound effect
- New installed capacity.

Please note that LUMA provides the following responses on a preliminary and informational basis.

List of Responses and Attachments

Response ID	Document Type	Response Subject
RFI-LUMA-AP-2023.0004-20240618-PREB-003a	Document CONFIDENTIAL	Rebound effect study - Ross C. Beppler, Daniel C. Matisoff, and Matthew W. Oliver (2021) Electricity consumption changes following solar adoption: Testing for a solar rebound
RFI-LUMA-AP-2023.0004-20240618-PREB-003a	Document	Rebound effect study - Luan Thanh Nguyen, Shyama Ratnasiri, Liam Wagner, Dan The Nguyen, Nicholas Rohde (2024) Solar rebound effects: short and long term dynamics

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-001a

SUBJECT

Available capacity of legacy units used in PLEXOS® modeling.

REQUEST

Re: Black and Veatch letter, pages 1-2, expansion planning module, "understanding the details behind the calculation of LOLP in the model allowed us to make appropriate adjustments so that consistent results are now being seen between the capacity expansion module and the production cost module of the software" for base case scenario.

- a. What specific adjustments, to which parameters, were made to obtain consistent results between the modules?


RESPONSE

LUMA's IRP Technical Consultant is not getting consistent Loss of Load Probability (LOLP) or Unserved Energy (UE, and collectively LOLP/UE) results from the Long Term (LT) and Short Term (ST) modules. However, the IRP Technical Consultant has adopted a revised model process that provides consistent results of unit additions and retirements with acceptable LOLP/UE results from the ST module. No changes were made to the resource modeling software parameters to address the LOLP/UE issue.

The primary change made to the modeling methodology to address the issues with the resource model's calculation of LOLP/UE in the LT module is that LUMA and the IRP Technical Consultant no longer rely on the LOLP/UE results from the LT module as the basis for resource decisions. The resource modeling software's method for calculating the LOLP/UE in the LT module is now known to vary significantly from the true LOLP/UE projection for the Puerto Rico system given its high forced outage rates. LUMA and the IRP Technical Consultant now use the LOLP/UE results from the ST module to assess the LOLP/UE performance of alternative portfolios. While using the LOLP/UE results from the ST module lengthens the process of assessing alternative portfolios, it assures the portfolios are being assessed with accurate projections of LOLP. LUMA and its IRP consultant have changed which LOLP/UE data is used to evaluate results, but no parameters were changed in the resource modeling software to address the issue with the LOLP/UE results. Figure 1 below provides an illustration of the iterative process that was adopted to address LOLP/UE driven difference in the LT and ST modules.

2024 INTEGRATED RESOURCE PLAN

Figure 1: Simplified Modeling Process Flowchart

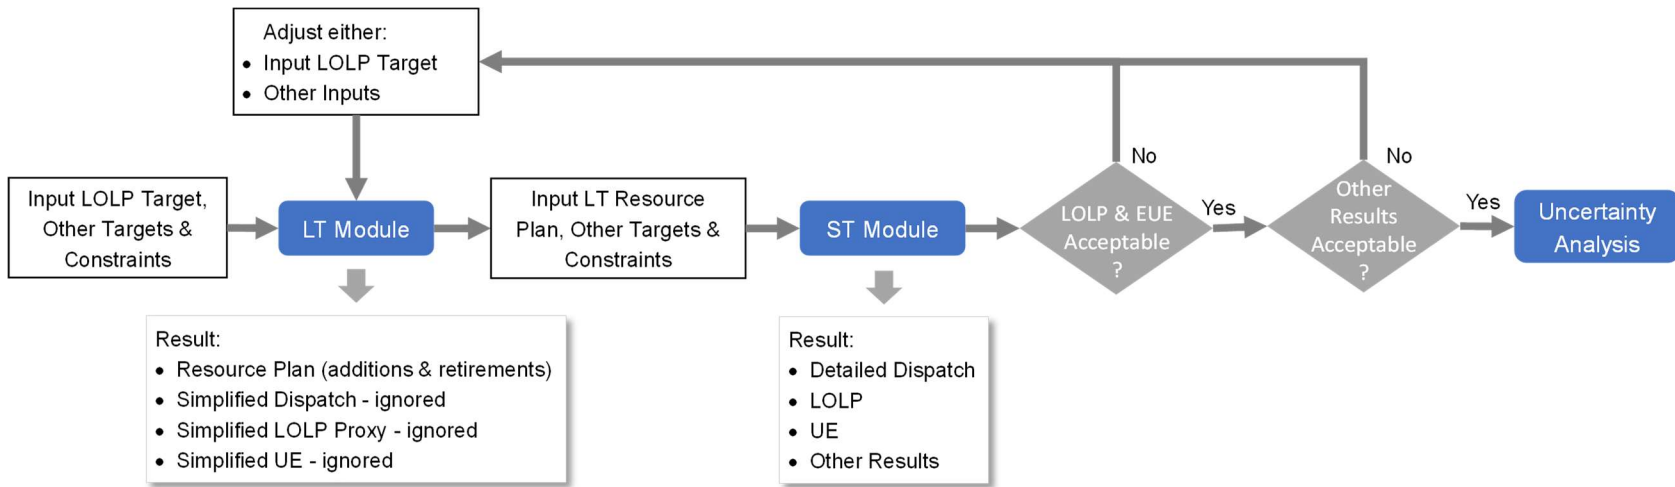

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-001b

SUBJECT

LOLP Model

REQUEST

Re: Black and Veatch letter, pages 1-2, expansion planning module, "understanding the details behind the calculation of LOLP in the model allowed us to make appropriate adjustments so that consistent results are now being seen between the capacity expansion module and the production cost module of the software" for base case scenario.

- b. As applicable, describe in full which PLEXOS LT Plan Chronology method was used - partial, fitted or sampled - and the reasons for its use.

RESPONSE

Partial LT Plan chronology was used to produce the expansion plan. Partial chronology with one duration curve for each Month with 21 blocks per month was used. The settings would produce 252 simulation periods (12 months X 21 blocks) per year which should capture resource needs for about 70% of the full year.

The IRP Technical Consultant is of the opinion this approach is better than using other chronology settings (Fitted or Sampled) for Puerto Rico's power infrastructure. Using Fitted chronology fits least square based load duration curve between samples. This approach simplifies load needs to be more flat than other methods and produces results that lose hourly level generation considerations in the LT model run. Sampled chronology biases the model to choose fewer select samples for the full planning horizon.

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-001c

SUBJECT

LOLP Model

REQUEST

Re: Black and Veatch letter, pages 1-2, expansion planning module, "understanding the details behind the calculation of LOLP in the model allowed us to make appropriate adjustments so that consistent results are now being seen between the capacity expansion module and the production cost module of the software" for base case scenario.

- c. Provide all input parameters used for the LT Plan or expansion planning module configuration for the base case scenario including all LT Plan Chronology details.

RESPONSE

Figure 1 below shows the modeling software of the LT plan input parameters. LUMA will file all input parameters used for the LT Plan or expansion planning module configuration for the base case scenario, including all LT Plan Chronology details with the 2024 IRP Report filing. At this time, this information is under review and will not be final until all the scenario resource portfolios are completed and validated.

2024 INTEGRATED RESOURCE PLAN

Figure 22: LT plan input parameters.

Step Size Step Size (years): <input type="text" value="1"/> Overlap (years): <input type="text" value="-1"/>	Discounting Discount Rate (%): <input type="text" value="8"/> End Effects Method: <input checked="" type="radio"/> None <input type="radio"/> Perpetuity <input checked="" type="checkbox"/> Limit Capital Cost Perpetuity by Economic Life Discount/Expansion Period: <input type="radio"/> Month <input type="radio"/> Quarter <input checked="" type="radio"/> Year <input type="checkbox"/> Always Annualize Build Cost Depreciation Method: <input type="radio"/> None <input checked="" type="radio"/> Straight-Line <input type="radio"/> Declining Tax Rate (%): <input type="text" value="0"/> Inflation Rate (%): <input type="text" value="0"/>	Transmission <input type="radio"/> Regional <input type="radio"/> Zonal <input checked="" type="radio"/> Nodal Heat Rate <input checked="" type="radio"/> Detailed <input type="radio"/> Simple <input type="radio"/> Simplest Storage <input type="checkbox"/> Restart each Expansion Period <input checked="" type="checkbox"/> Formulate Head Effects Outages <input type="checkbox"/> Use Effective Load Approach <input checked="" type="checkbox"/> Compute Reliability Indices <input type="checkbox"/> Compute Multi-area Reliability Indices <input type="text" value="10"/> Outage Increment (MW) <input type="checkbox"/> Maintenance Sculpting
Chronology <input checked="" type="radio"/> Partial <input type="radio"/> Fitted <input type="radio"/> Sampled One Duration Curve each: <input type="radio"/> Day <input type="radio"/> Week <input checked="" type="radio"/> Month <input type="radio"/> Quarter <input type="radio"/> Year Blocks in each Duration Curve: <input type="text" value="21"/> Blocks in last curve in Horizon: <input type="text" value="0"/> Slicing Method <input checked="" type="radio"/> Peak/Off-peak Bias <input type="radio"/> Weighted Least-squares Fit Pin Top: <input type="text" value="-1"/> Pin Bottom: <input type="text" value="-1"/>	Expansion Algorithm <input checked="" type="checkbox"/> Optimize Expansion Decisions Integer Optimality: <input type="radio"/> Linear <input checked="" type="radio"/> Integer Integerization Horizon (years): <input type="text" value="-1"/> <input type="checkbox"/> Allow Capacity Sharing <input type="checkbox"/> Co-optimize Unit Commitment	Stochastic Method <input checked="" type="radio"/> Deterministic <input type="radio"/> Sequential Monte Carlo <input type="radio"/> Parallel Monte Carlo <input type="radio"/> Stochastic
Sample <input type="text" value="24"/> <input type="text" value="Day"/> per <input type="text" value="Year"/> Blocks in each Sample: <input type="text" value="12"/> Number of Years Sampled: <input type="text" value="0"/>	Solution Hierarchy Number of Solutions: <input type="text" value="1"/> Solution Quality (%): <input type="text" value="0"/>	Pricing Generation Pricing Method: <input checked="" type="radio"/> Average <input type="radio"/> Marginal Start Cost Amortization (hrs): <input type="text" value="0"/> <input type="checkbox"/> Make Capacity Payments
	Output <input checked="" type="checkbox"/> Write Expansion Plan to Text Files	Bridge <input checked="" type="checkbox"/> Constraints <input checked="" type="checkbox"/> Storage

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-001d

SUBJECT

LOLP Model

REQUEST

Re: Black and Veatch letter, pages 1-2, expansion planning module, "understanding the details behind the calculation of LOLP in the model allowed us to make appropriate adjustments so that consistent results are now being seen between the capacity expansion module and the production cost module of the software" for base case scenario.

- d. At the time of the full core scenarios filing, include the top 20 "suboptimal solutions"¹ available from the model for the base case scenarios.

RESPONSE

LUMA will include as part of the 2024 IRP Report filing the top 20 "suboptimal solutions" available from the model for the base case scenarios.

¹ See PLEXOS LT Plan Solution Count page, "Solution Count is the maximum number of solutions produced in the Solution Hierarchy. By default, LT Plan will only compute the global optimal solution in terms of the expansion and production decisions. Setting this value to a number greater than one causes the simulator to continue finding combinations of the expansion decisions, and resulting production outcome, in order from optimal to second-to-optimal, third-to-optimal etc...." Available at <https://portal.energyexemplar.com/unified-help/plexos-desktop/LTPlan.SolutionCount.html> (last visit, June 13, 2024).

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-002a

SUBJECT

Generation resources currently planned or contracted for deployment used in PLEXOS®

REQUEST

Re: Responses to Third ROI Question No. 3 [of the Third 2024 IRP Prefiling ROI]. Question No. 3 requested modeled Puerto Rico deployment dates for all resources. The response did not provide modeled deployment dates for resources other than Tranche 1 PV and battery storage resources and phase 1 of the ASAP battery resources.

- a. Provide modeled deployment dates, even if estimated, for all Tranche 2 resources listed in Table 4 of the response to 3rd ROI No. 3

RESPONSE

See Table 1 below. The information contained in Table 1 is based on the latest information made available to LUMA in relation to the Tranche 2 renewable energy resource procurement process.

Table 1: Updated Tranche 2 total capacities

Tranche 2	Solar PV Capacity	BESS	Modeled Deployment Date
Tranche 2 Total	REDACTEDREDACTEDREDACTED		

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-002b

SUBJECT

FEMA emergency generation.

REQUEST

Re: Responses to Third ROI Question No. 3 [of the Third 2024 IRP Prefiling ROI]. Question No. 3 requested modeled Puerto Rico deployment dates for all resources. The response did not provide modeled deployment dates for resources other than Tranche 1 PV and battery storage resources and phase 1 of the ASAP battery resources.

- b. Provide modeled deployment dates, even if estimated, for all RICE and CT Units proposed by Genera, listed in Table 5 if the response to 3rd ROI No. 3.

RESPONSE

The Commercial Operation Dates for the RICE and CT resources proposed by Genera are summarized in the table below.

Table 2: RICE and CT Units proposed by Genera.

Location	Power Source	Expected Capacity (MW)	Commercial Operation Date
Costa Sur	REDACTEDREDACTED	REDACTED	REDACTED
San Juan	REDACTEDREDACTED	REDACTED	REDACTED
Daguao	REDACTEDREDACTED	REDACTED	REDACTED
Jobos	REDACTEDREDACTED	REDACTED	REDACTED
Yabucoa	REDACTEDREDACTED	REDACTED	REDACTED
TOTAL		REDACTED	

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-002c

SUBJECT

BESS resources.

REQUEST

Re: Responses to Third ROI Question No. 3 [of the Third 2024 IRP Prefiling ROI]. Question No. 3 requested modeled Puerto Rico deployment dates for all resources. The response did not provide modeled deployment dates for resources other than Tranche 1 PV and battery storage resources and phase 1 of the ASAP battery resources.

- c. Provide modeled deployment dates, even if estimated, for all BESS resources proposed by Genera, listed in Table 6 of the response to 3rd ROI No. 3

RESPONSE

The commercial operation date of the Battery Energy Storage System (BESS) resources proposed by Genera is showcased in the table below:

Table 3: Battery Energy Storage System (BESS) Resources proposed by Genera.

Location	Power Source	Expected Capacity (MW)	Commercial Operation Date
Costa Sur	BESS	40	April 2026
Aguirre	BESS	142	December 2025
Yabucoa	BESS	40	June 2026
San Juan	BESS	48	May 2026
Palo Seco	BESS	28	March 2026
Vega Baja	BESS	52	November 2025
Cambalache	BESS	80	January 2026
TOTAL		430	

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-002d

SUBJECT

ASAP batteries resources

REQUEST

Re: Responses to Third ROI Question No. 3 [of the Third 2024 IRP Prefiling ROI]. Question No. 3 requested modeled Puerto Rico deployment dates for all resources. The response did not provide modeled deployment dates for resources other than Tranche 1 PV and battery storage resources and phase 1 of the ASAP battery resources.

- d. Explain why LUMA plans to include only the first phase of the ASAP batteries (in Table 7 of the response to 3rd ROI No. 3.) as a fixed decision.

RESPONSE

LUMA's ongoing assumption is to only use the first phase of the ASAP batteries as a fixed decision in the PLEXOS model due to the project's current stage. The ASAP batteries program is expected to be implemented during the first quarter of CY 2026.

Accordingly, LUMA and the IRP Technical Consultant have incorporated the second phase of the ASAP batteries program as optional. This means PLEXOS will evaluate and potentially include the second phase if it proves to be economically viable. This second phase is considered optional because, with the simultaneous implementation of several battery projects, such as Tranche 1, Tranche 2, and Genera batteries, an excess of battery capacity may be encountered during the upcoming years, making additional batteries less critical in the timeline proposed (CY 2027).

The updated ASAP program implementation dates, together with the expected capacity and energy from each phase is summarized in the table below:

Table 4: Additional BESS Resources from ASAP Program with updated dates

Implementation Date	Expected Capacity (MW)	Expected Energy (MWh)
Phase 1- Q1 CY 2026	185	740
Phase 2 – Q1 CY 2027	175	700

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-002e

SUBJECT

ASAP batteries resources

REQUEST

Re: Responses to Third ROI Question No. 3. [of the Third 2024 IRP Prefiling ROI]. Question No. 3 requested modeled Puerto Rico deployment dates for all resources. The response did not provide modeled deployment dates for resources other than Tranche 1 PV and battery storage resources and phase 1 of the ASAP battery resources.

- e. Confirm or explain otherwise that the modeled deployment date of the first phase of ASAP batteries is in CY2025, and state which month of CY2025 the deployment will be modeled in PLEXOS.

RESPONSE

LUMA's ongoing assumption is that the first phase of ASAP batteries is scheduled for deployment in the first quarter of calendar year 2026.

For modeling purposes, the deployment date is set for 1/1/2026.

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-003a

SUBJECT

Rebound effect.

REQUEST

Re: Response to 3rd ROI Question No. 9b, concerning the proposed use of a 28.5% rebound effect load for small solar PV installations.

- a. Provide the two studies listed in response to 9b.

LUMA has assumed a 28.5% rebound effect based on empirical studies and analyses relevant to Puerto Rico. Published articles that reference a typical 28.5% rebound effect in the United States when installing residential DPV systems are showcased below:

- Ross C. Beppler, Daniel C. Matisoff and Matthew W. Oliver (2021) Electricity consumption changes following solar adoption: Testing for a solar rebound
<https://onlinelibrary.wiley.com/doi/10.1111/ecin.13031>
- Luan Thanh Nguyen, Shyama Ratnasiri, Liam Wagner, Dan The Nguyen, Nicholas Rohde (2024) Solar rebound effects: Short and long term dynamics
<https://www.sciencedirect.com/science/article/pii/S0960148124001162>

RESPONSE

See attachments:

RFI-LUMA-AP-2023.0004-20240618-PREB-003a_Electricity consumption changes following solar adoption Testing for a solar rebound, LUMA files this document as confidential, considering it is proprietary information belonging to a third party.

RFI-LUMA-AP-2023.0004-20240618-PREB-003a_Solar rebound effects short and long term dynamics

© 2024 The Authors. Published by Elsevier Ltd. This is an open access article licensed under the Creative Commons Attribution 4.0 International Public License ("Public License"), <https://creativecommons.org/licenses/by/4.0/legalcode.en#s5>. Under the Public License, LUMA may copy and redistribute the material in any medium or format for any purpose, even commercially. Pursuant to Section 3(a)(1) of the Public License, LUMA certifies it has not modified the licensed material and recognizes the Disclaimer of Warranties and Limitation of Liability contained in Section 5 of the Public License.

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-003b

SUBJECT

Rebound effect.

REQUEST

Re: Response to 3rd ROI Question No. 9b [of the Third 2024 IRP Prefiling ROI], concerning the proposed use of a 28.5% rebound effect load for small solar PV installations.

- b. Explain how the proposed 28.5% rebound effect "based on empirical studies and analyses relevant to Puerto Rico" is actually relevant to Puerto Rico and provide any Puerto Rico specific evidence in support of that assertion.


RESPONSE

LUMA determined that the rebound effect is embedded within the load forecast and has been preliminarily estimated to be approximately 28.5% based on U.S. studies. However, this estimate is still under review and LUMA is working to achieve an assessment tailored to Puerto Rico's conditions. Nevertheless, for the purpose of this IRP, LUMA has assumed the 28.5% value in the forecasts currently used for the 2024 IRP development.

The gross load for Net Energy Metering (NEM) customers is included in the base load forecast. This means that the total energy consumption, including any potential increases due to the rebound effect, is already accounted for in the load projections for the LUMA distribution system. This inclusion ensures that all energy provided to NEM customers by LUMA is considered. This increase is already reflected in the aggregate load measurements in case the NEM customers increase their energy consumption during peak hours due to the rebound effect. During these periods, NEM customers would be consuming energy from the same energy sources as other consumers in the system, both renewable and non-renewable sources. See Figure 3 below for more information:


2024 INTEGRATED RESOURCE PLAN

Figure 33: Net consumption diagram with embedded rebound effect.

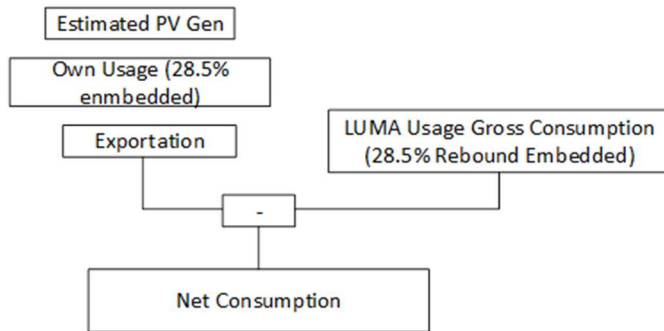

If NEM customers were to increase their energy consumption during solar hours because of the rebound effect, their exported energy would decrease. Consequently, as showcased below, the remaining customers would be receiving energy from the large-scale generation fleet, which includes both renewable and fossil fuel sources.

Figure 44: Diagram showcasing daily electricity consumption.

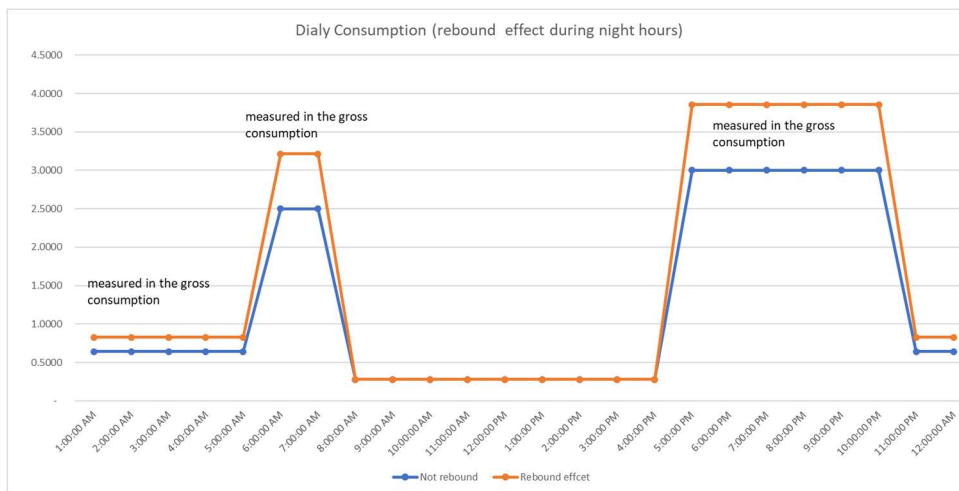

In summary, LUMA’s load forecast incorporates the potential impact of the rebound effect for NEM customers, covering both peak and solar hour scenarios.

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-004a

SUBJECT

LOLP Target.

REQUEST

Re: Response to Question No. 6. [Third 2024 IRP Prefiling ROI]

- a. In response to Question 6a and 6b, LUMA states that it will not use an LOLP target until 2030 and states that 2030 is the earliest date that new capacity could be added to the model.
 - i. Confirm or explain otherwise that the model will thus utilize only existing or "fixed decision" resources such as those listed in the response to Question 3 of the Third Set of ROIs for all simulation runs for the years 2025 through 2029.
 - ii. Confirm or explain otherwise that the model will allow new resources to be available at the beginning of the 2030 year and thus present if economically built by the model in simulations for the year 2030.

RESPONSE

- i. LUMA ongoing assumption is to only use fixed decision resources for the years 2025 through 2029 for each of the 10 resource portfolios optimized for each of the 10 scenarios.
- ii. LUMA confirms that the model will allow new resources to become available from the year 2030 onwards if economically built by the model.

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-004b

SUBJECT

New installed Capacity

REQUEST

Re: Response to Question No. 6. [Third 2024 IRP Prefiling ROI]

- b. On what basis does LUMA assume that "2030 was the earliest new capacity that could be added in the 2024 IRP", as stated page 20 in response to 6b?

RESPONSE

LUMA's ongoing assumption is that, other than existing fixed decisions, new thermal generation resources will not be added prior to January 2030. This assumption is based on LUMA's experience and procurement timelines for Tranche 1 and 2² and the expected timelines required to complete the multiple steps associated with the addition of new generation resources, including planning, procurement, interconnection analysis, contract approvals, permitting, engineering, construction, and commissioning. LUMA's ongoing assumption is also that it is unlikely that such resources would not be committed to until the Energy Bureau issues a final determination in connection with the ongoing IRP process. LUMA currently assumes the approval of the ongoing IRP process would occur by the end of the 3rd quarter of calendar year 2025 (Q3 CY2025), allowing 4 years and 3 months (4.25 years) until January 2030. As such, LUMA has incorporated only fixed decisions³ in the simulation runs for the period from 2025 to 2029.

² After the approval of the Energy Bureau, PREPA issued Tranche 1 for bid on February 22, 2021, as stated in the motion of the same date for Case: NEPR-MI-2020-0012, Subject: Issuance of Renewables RFP Tranche 1. Tranche 1 resources are scheduled to be operational in 2026, approximately 5 years after the Energy Bureau approval of the RFP. This 5-year period for Tranche 1 does not include the time spent to obtain the Energy Bureau's approval for the RFP or the time to develop the RFP. On September 28, 2022, the Energy Bureau, through its Independent Coordinator Accion Group and on behalf of PREPA, issued a Request for Proposals for Tranche 2. While the Tranche 2 contracts are not yet finalized, the Tranche 2 projects are expected to be operational in 2026, approximately 4 years from the issuance of the RFP. This 4-year period for Tranche 2 does not include the time spent to obtain the Energy Bureau's approval for the RFP or the time to develop the RFP.

³ These fixed decisions include projects that have already been approved or are at an advanced stage of the approval process.

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-004c

SUBJECT

New installed capacity.

REQUEST

Re: Response to Question No. 6. [Third 2024 IRP Prefiling ROI]

- c. Please explain fully how LUMA considers all relevant factors that may lead to delays in the operation of new capacity or energy resources in Puerto Rico

RESPONSE

LUMA and its Technical Consultant have developed an estimate of a typical project lead time for the operation of new energy resources in Puerto Rico. The estimated lead time is based upon a review of historical project procurement life cycles observed in Puerto Rico. The assumption considers “typical factors” that impact the schedule of energy resource projects for the technology types being considered for early years of the 2024 IRP. LUMA’s estimates of the project lead time primarily impact the technologies that could be installed within the first 5 years of the IRP resource plan (e.g., solar, land-based wind, energy storage, reciprocating internal combustion engines and combustion turbines, fueled by either renewable or fossil fuels) but would not impact the technologies that are expected to require a longer lead time (e.g., offshore-wind, marine cable connections). The 2024 IRP will consider potential delays in operation of new capacity or energy resources using two primary methods, conservative schedule assumptions for resources and sensitivity analysis of resource schedules as further described below:

1. Conservative schedule assumptions for resources – As explained in LUMA’s response to question 4b, LUMA is only considering fixed decisions for projects planned for operation prior to 2030 for each of the 10 resource portfolios optimized for each of the 10 scenarios. This project lead-time of approximately 4.25 years following the assumed Q3 CY2025 Energy Bureau approval the 2024 IRP will allow a reasonable lead time for a typical simple cycle or combined cycle project, requiring air quality permitting or a renewable or storage technology. While the lead-times for each of these technologies could potentially be shorter, LUMA believes the lead-time is appropriate for the purposes of developing a practical and reasonably conservative 2024 IRP.

2024 INTEGRATED RESOURCE PLAN

2. Sensitivity analysis of resource schedules – Sensitivity analysis is a proven and accepted industry planning practice to evaluate the impact of the uncertainty associated with specific assumptions, such as project schedules. LUMA plans to include sensitivity analysis in its assessment of the optimized portfolios that result from the scenarios. Sensitivity analysis is a proven planning practice used in the industry to evaluate the impact of highly uncertain projects or schedules..

2024 INTEGRATED RESOURCE PLAN

Attachment A

NEPR-AP-2023-0004

Response: RFI-LUMA-AP-2023.0004-20240618-PREB-004d

SUBJECT

New installed capacity.


REQUEST

Re: Response to Question No. 6. [Third 2024 IRP Prefiling ROI]

- d. Provide any additional information necessary to understand how LUMA and Black and Veatch determined the earliest year of deployment allowed in the model.

RESPONSE

Please refer to response RFI-LUMA-AP-2023.0004-20240618-PREB-004b.



Solar rebound effects: Short and long term dynamics

Luan Thanh Nguyen^{a,*}, Shyama Ratnasiri^a, Liam Wagner^b, Dan The Nguyen^c, Nicholas Rohde^a

^a Griffith University, Australia

^b The University of Adelaide, Australia

^c Hanoi Power Corporation, Viet Nam

ARTICLE INFO

JEL classification:

O13
P28
Q42

Keywords:

Solar power
Renewable energy
Rebound effects
Consumer behaviour
Rooftop solar
Residential electricity

ABSTRACT

Rooftop solar is increasingly promoted as a source of low-carbon household energy; however, there is a plausible concern that solar installations might influence energy consumption patterns in ways that undermine potential environmental benefits. In this study, we examine the impact of residential rooftop solar panels on energy usage in Vietnam. Leveraging a comprehensive and unique panel dataset, we employ a difference-in-differences identification strategy to estimate the effects of solar installation on consumption. Our models reveal that households installing solar panels reduce grid consumption (typically carbon-intensive) by approximately 3.6 %. This reduction occurs concomitantly with an increase in total consumption of around 16 %, indicating a substantial rebound effect from solar panels. Nonetheless, dynamic models suggest a diminishing trend over time for both the decline in grid usage and the rebound effect, leveling off to 1.5 % and 3.5 %, respectively, within one year of solar installation. Acknowledging the marked differences in household consumption behavior and electricity demand dynamics between developing and developed nations, our research provides valuable insights into the understanding of the solar rebound effect and its dynamics over time.

1. Introduction

Replacing fossil fuels with renewable energy sources is considered one of the most viable options for mitigating climate change [1]. However, the success of solar installations in reducing carbon emissions depends heavily on their ability to substitute for other sources of energy, particularly grid electricity that runs on fossil fuels. If households that adopt solar panels also substantially change their energy consumption patterns, it is possible that the overall carbon emissions associated with energy use may be relatively unchanged. This phenomenon is known as a “rebound effect”, where increased supply fails to induce substitution between solar and grid energy.

In this paper, we investigate the efficacy of residential solar energy in mitigating carbon-intensive energy consumption. Our motivation stems from the possibility that a rebound effect may occur through various behavioral changes, some of which could paradoxically counteract the environmental benefits of adopting clean energy. Renewable energy adoption is influenced by both non-financial motivations and financial incentives [2–4].

Regarding non-financial motivations, there is a consensus that solar adoption is both encouraged by and encourages more environmentally

responsible behavior [5,6]. However, the effectiveness of these behavioral interventions may be observable only over short periods or may not always be sustained over the long term [7,8]. The rebound effect can be explained by moral licensing, wherein solar users may consume more energy under the assumption that they have already taken a morally responsible action by installing solar PV [9,10]. On the financial front, the rebound effect may manifest when consumers perceive solar energy as synonymous with “free electricity.” This perception is particularly pronounced in contexts like Vietnam, where the initial phase of promoting rooftop solar power installation employs the net metering mechanism. Under this mechanism, the solar power output generated is essentially free for consumption, given that the marginal price of electricity is zero [11].

We address this issue through an analysis of a distinctive panel dataset encompassing approximately 3500 households in Hanoi, Vietnam, focusing on their energy consumption patterns. Employing a difference-in-differences methodology, we assess the structural shifts in solar and grid energy utilization before and after households adopt solar panels. Our model findings indicate a modest 3.6 % reduction in grid electricity consumption among solar energy adopters, relative to non-solar households. Conversely, post-solar system installation, total

* Corresponding author. Griffith Business School, Griffith University, G42, 1 Parkland Drive, QLD, 4215, Australia.

E-mail address: leon.nguyen@griffith.edu.au (L.T. Nguyen).

<https://doi.org/10.1016/j.renene.2024.120051>

Received 20 February 2023; Received in revised form 21 January 2024; Accepted 23 January 2024

Available online 28 January 2024

0960-1481/© 2024 The Authors. Published by Elsevier Ltd. This is an open access article under the CC BY license (<http://creativecommons.org/licenses/by/4.0/>).

power demand among solar users exhibits a 16 % increase compared to homes without solar energy. Thus, the potential of household solar panels to substantively mitigate carbon emissions seems to be adversely affected.

We further explore the temporal dynamics of both total electricity demand and grid power demand over a twelve-month period following the installation of solar systems. Our findings reveal a significant initial expansion in the gap between the total electricity demands of rooftop solar owners and non-solar households, as mentioned above at 16 %, which gradually diminishes over time, ultimately converging to 3.5 % after the twelve-month observation period. Simultaneously, an opposing trend is observed in grid electricity consumption. Initially, the reliance on the grid by solar prosumers is 3.6 % lower than that of non-solar households, yet this disparity contracts to 1.5 % over the same period. These dynamics suggest a partial reversion in the behavior of solar owners towards increased dependency on the grid. This trend may be attributed to factors such as a less attractive feed-in tariff, limited adoption of battery technology, and the persistence of entrenched long-term behavioral patterns.

After obtaining these baseline results, we perform a set of model diagnostics related to causality/identification. These include an examination of parallel trend assumptions, running a placebo regression, and using stability assessments to simulate the potential effects of unobserved confounding. Our models perform well in all instances, suggesting that our estimates are likely to be causal.

Our results are associated with the rebound effect, a conservation or energy economics concept on an adverse behavioral response to new technologies, which are usually more economical or efficient. The rebound effect was initially known as Jevons' [12] paradox and revisited in Khazzoom [13] before being widely adopted in a series of analyses for various energy services, especially papers focusing on energy efficiency. Some examples of this include but are not limited to studies by Du et al. [14], Wei & Liu [15], Zhang & Lin Lawell [16], Turner [17], Freire González [18], Mizobuchi [19], Frondel et al. [20], Dimitropoulos [21], and Bentzen [22]. The detailed surveys of the rebound effect in earlier literature can be found in studies by Sorrell et al. [23] and Greening et al. [24].

The solar rebound effect has become a focal point in scholarly discourse, with recent empirical studies consistently reinforcing findings from earlier research on this phenomenon. Notably, Beppler et al. [25] observed a rebound effect of 28.5 % in the eastern United States. Bocard & Gautier [26] contributed evidence revealing a significant rebound effect in consumption, often resulting in oversized installations due to a generous subsidy scheme in Wallonia, Belgium. Qiu et al. [27] reported a positive indication of a rebound effect in Arizona, showcasing an 18 % increase in electricity consumption from solar energy production. Investigations into Australian households identified a rebound effect ranging from 16 % to 20 % in the consumption patterns of solar owners in Sydney from 2007 to 2014, with the prospect of a more pronounced effect under a higher feed-in tariff [28–30].

Our study modestly contributes to the emerging field by investigating the solar energy rebound effect in a developing country context. Recognizing that household consumption behavior and electricity demand dynamics in developing countries differ significantly from those in developed nations, our research adds valuable insights to the understanding of the solar rebound effect. Leveraging a substantial, distinctive, and up-to-date panel dataset, we unveil a substantial rebound effect that challenges the presumed environmental advantages of residential solar energy. We are also (to our knowledge), among the first authors to study the dynamics of this process and show that both the primary effect and the rebound effect tend to diminish over time.

The paper is structured as follows. Section 2 introduces the data set and variables. Section 3 presents our baseline estimates and discusses the immediate implications. Section 4 studies the dynamic properties of our data and Section 5 undertakes some causal diagnostics. Section 6 discusses some policy implications and Section 7 concludes.

2. Data

We employ two datasets, household-level panel data and aggregated district-level panel data of Hanoi Capital, Vietnam. The household data are an unbalanced panel of more than 3550 households in Hanoi from 2015M1–2021M11, in which 1688 households are solar energy consumers and 1862 households do not use solar energy. It contains detailed monthly information on electricity demand and bill, solar system capacity, production, and installation time. This data are collected from the customer database of Hanoi Power company with encrypted identity information for privacy purposes. Meanwhile, the district-level data are a balanced panel dataset that provides aggregated social economics information of Hanoi's 30 administrative regions (districts) in the same period. Because not all households' socioeconomic and demographic were available, we adopted district-level data as proxies for exogenous impact factors to overcome that situation. The district-level data are balanced data published annually in Statistical Yearbooks by the Vietnamese Statistics Office.

2.1. Electricity demand variables

Total electricity consumption, y_{it}^1 , and electricity purchased from the grid network, y_{it}^2 , are monthly data of household i in month t .¹ They are measured in kilowatt-hour (kWh) and transformed into logarithmic form before being adopted into the models. Values of y_{it}^1 and y_{it}^2 are identical for those households that do not install or had not installed solar energy systems. Notably, all homes in the dataset did not possess solar batteries, but none fed solar energy into the national grid. It means all solar owners either consumed all solar production or wasted it, and the solar energy output always equals the subtraction of y_{it}^1 to y_{it}^2 .

2.2. Electricity price variables

The retail electricity tariff in Vietnam for residential purposes is the tier rate, in which the rate will increase after every 100 kWh of electricity consumed. It means that the individual household power price is endogenous to the demand. Thus, we calculate the average monthly electricity price for the whole administrative region, $aveprice_{dt}$, based on total bill and total demand at the district, d in month t . The variable ce_{dt} , which is measured in Vietnam Dong per kilowatt-hour, is then deflated and transformed into logarithm form before being input into the models. This proxy satisfies the price variable's exogenous requirement.

In addition, the impact of average electricity price on household demand could be influenced by the urbanisation rate of each district, i.e. $urban_{dt}$. Specifically, the more developed the district is, the more dependent households are on electronic devices. Consequently, the influence of electricity prices on consumption in lower urbanisation areas

¹ In the initial phase of promoting the development of residential solar power systems, the Vietnamese government actively endorsed a net-metering initiative. As part of this initiative, households in Hanoi installing rooftop solar power systems were mandated to have bi-directional electricity meters, ensuring the compulsory monthly recording of solar power self-consumption, and any surplus electricity transmitted to the grid. However, this program faced a setback due to the absence of guidance on finalization, payment schemes, and invoicing mechanisms from the Ministry of Industry and Trade and the Ministry of Finance. Consequently, the implementation of this initiative had to be halted. Subsequently, a new payment scheme for rooftop solar projects was introduced in the form of the feed-in-tariff (FIT). During the FIT policy period, electricity generated by rooftop solar power projects was consistently metered independently. The electricity supplied by Hanoi Power to consumers, including rooftop solar power investors, underwent regular metering procedures similar to those applied to other households and consumers. Therefore, the monthly total electricity consumption of each household is recorded as the sum of the power obtained from the grid and the actual amount used from the rooftop solar system.

could be more substantial than that in more developed districts. Thus, an interaction term between price and urbanisation rate, $aveprice_{dt} \times urban_{dt}$, is included in models to capture this effect.

2.3. Income variables

We use aggregate-level income averaged by districts as a proxy for each households' economic status. We use this approximate method as unit record data on household income is not available. This approximation is likely to be reasonable given the spatial associations in socioeconomic well-being usually seen in microdata [31–33]. Variable $income_{dt}$, measured in Vietnam Dong, is deflated and transformed into logarithm form. We also include a quadratic term of log of income into our model to allow for any potential nonlinear effects.

2.4. Other social demography variables

Other socio-demographic covariates, which potentially influence the power demand, are also included in our model. For instance, the number of families living in the same house, $family_{it}$, may positively correlate to the demand. Meanwhile, the urbanisation rate ($urban_{dt}$), the employment rate (emp_{dt}) and the rate of households having more than two children ($thirdchild_{dt}$), which reflect the socioeconomic development of each district, are also adopted. Finally, the number of new rooftop solar installed in the district each month, $solarcount_{dt}$, helps capture the solar adaptation level of the neighbourhood.

The descriptive statistic of the dataset is provided in Table 1.

Table 1
Descriptive statistics of the dataset.

Variable	Description	Mean	Std. dev.	Min	Max
y_{it}^1	Total electricity demand (log form)	5.79	0.82	3.69	8.35
y_{it}^2	Amount of electricity purchased from the network (log form)	5.71	0.81	0.00	8.34
$month_t$	t-1 dummy variables for t months	44.66	23.99	1.00	83.00
D_{it}	Dummy variable of the installation period - $D_{it} = 1$: the solar system is installed - $D_{it} = 0$: not installed yet	0.13	0.34	0.00	1.00
$family_{it}$	No. of families in the household	1.11	0.44	0.00	8.00
$income_{dt}$	Log of average households' income (by district)	8.99	0.21	8.30	9.51
$price_{dt}$	Log of average electricity retail price (by district)	7.57	0.15	6.22	7.77
$urban_{dt}$	Urbanization rate (by district)	60.92	45.78	1.56	100.00
emp_{dt}	The employment rate (by district)	37.85	22.56	2.25	125.18
$solarcount_{dt}$	Number of the new solar system installations (by district)	1.12	2.96	0.00	44.00
$thirdchild_{dt}$	The rate of households have more than two children	4.62	4.39	0.10	20.20

Notes.

- Table 1 presents the descriptive statistics of the data used in this study.
- The first column displays the names of variables, which are included in the model in Eq (1). Meanwhile, the second column shows the meaning and how to transform variables from the raw dataset.
- The dataset is unbalanced panel data, consisting of observations of 3550 households in 83 months from January 2015 to November 2021. In the data, 1688 solar energy consumers reflect the whole population; and 1862 households are samples of non-solar houses, which are randomly provided without any intervention or influence by the authors.

3. Analysis of the rebound effect

3.1. Baseline models

We are interested in assessing the changes in household consumption behaviour after installing solar systems, reflected in power consumption and grid electricity demand. We set up a difference-in-differences (hereafter, DID) design, in which solar energy adoption was not geographically specified and the installation point is time-variant by households.²

Let y_{it} denotes the electricity demand of household i at months t ; D_{it} is a dummy for the treatment, i.e., solar installation, that distinguish by households and time³; α_i are households' time-invariant fixed-effects; λ_t are time fixed-effects; and, \mathbf{x}_{it} is the vector of exogenous variables and interaction terms. For potential unobserved variables, the fixed effects estimation will help to capture their impacts. We define baseline models, including a model for total electricity demand and a model for power demand from the grid, as follows:

$$y_{it}^E = \alpha_i^E + \lambda_t^E + \theta^E y_{it-1}^E + \delta^E D_{it} + \mathbf{x}_{it}' \beta^E + \varepsilon_{it}^E \quad (1)$$

where the superscript E is to distinguish a model for total electricity demand, i.e., y_{it}^1 , from a model for power demand from the grid, i.e., y_{it}^2 . In addition, residential power consumption is usually serially correlated, even after applying controlling methods like time-variant fixed-effect dummies. It is potentially caused by the accumulation of electrical devices or the stability of household financial conditions in the short term [30]. Thus, we accepted the setup with both fixed effects and lagged dependent variable, y_{it-1}^E .

Baseline models in Eq. (1) can be estimated by least squares, and estimation outputs are displayed in Table 2. In Table 2, the dependent variables in columns (1) and (2) are the logarithm of households' total electricity consumption, $\log(y_{it}^1)$. Meanwhile, dependent variables in columns (3) and (4) are the logarithm of grid electricity demand, $\log(y_{it}^2)$. All models included households' time-invariant fixed-effects and time fixed-effects, but they are not shown in the output for simplicity of exposition. The only differences between models in each pair are the inclusion or exclusion of exogenous variables, and those differences are to test the consistency of the estimations.

3.2. Implication of static estimates

The estimation of the treatment dummy, D_{it} , in Model (1) showed a highly significant and positive impact on households' total electricity demand. It implies that solar installations immediately increased the total electricity demand by approximately 16.3 %, i.e., suggesting the existence of a rebound effect of solar installation. The parameter of D_{it} in Model (2) also provided a similar pattern, which was 18.1 %, to confirm that the estimations are only marginally different regardless of the presence or absence of other exogenous variables. These results were analogous to the findings in studies of Qiu et al. [27] and Deng and Newton [30], in which increases in total electricity demand were 18 % in Arizona and more than 16.7 % in Sydney, respectively.

² In other words, the difference between this model and an ordinary DID model is that the treatment group is not naturally assigned, and some households get treated at particular times while others do not. Nonetheless, the DID panel model is still suitable because we have panel data of the same families over time [41].

³ The pre/post-treatment periods are identified by dummy variables, D_{it} , while the identity of treatment/control groups is omitted because the model already includes time-invariant household variant fixed effects. Thus, variable D_{it} indicates two different periods, before ($D_{it} = 0$) and after ($D_{it} = 1$) installing the solar system, for each solar energy owner. Households that do not have a solar system will have $D_{it} = 0$ in all observations.

Table 2
Estimates output of baseline models.

	(1)	(2)	(3)	(4)
Solar installation (treatment)	0.163*** (0.006)	0.181*** (0.006)	-0.036*** (0.005)	-0.032*** (0.005)
Log of total electricity demand (lagged)	0.693*** (0.005)	0.699*** (0.005)		
Log of grid electricity demand (lagged)			0.701*** (0.005)	0.702*** (0.005)
Average electricity price (log)	-0.150*** (0.017)		0.025* (0.014)	
Urbanisation rate (%)	0.004 (0.005)		0.011** (0.005)	
Average electricity price (log)* Urbanisation rate	0.002*** (0.000)		-0.00007 (0.000)	
Income (log)	3.454*** (0.470)		2.261*** (0.467)	
Squared income (log)	-0.191*** (0.026)		-0.126*** (0.026)	
Number of families	0.017** (0.007)		0.019** (0.008)	
Employment rate	-0.001 (0.000)		-0.001** (0.000)	
Rate of household having more than 3 kids	0.0003 (0.001)		-0.0003 (0.001)	
Observations	223,562	223,562	223,562	223,562
R-squared	0.660	0.658	0.594	0.594
Groups	3544	3544	3544	3544
Average group size	63.08	63.08	63.08	63.08
Panel-level standard deviation (σ_u)	0.720	0.195	0.427	0.217
Standard deviation of ϵ_{it} (σ_e)	0.286	0.287	0.294	0.295
Adjusted R-squared	0.660	0.658	0.594	0.594
R-squared within model	0.660	0.658	0.594	0.594
R-squared overall model	0.507	0.852	0.647	0.842
R-squared between model	0.559	0.991	0.721	0.997

Notes.

- The dependent variables in models (1) and (2) are the household's total electricity consumption (in log form).
- The dependent variables in models (3) and (4) are the household's grid electricity demand (in log form).
- All models include households' time-invariant fixed-effects and time-variant fixed-effects.
- Standard errors are clustered at the household level and reported in parentheses.
- ***, **, *: significant at the significant level of 1 %, 5 % and 10 %.

In the following estimations, the coefficient of D_{it} in Model (3) expressed a decrease of 3.6 % in grid power demand. A similar estimate of D_{it} in Model (4) highlights the robustness of this result. Jointly, these estimates imply that solar adaptation contributed to replacing a part of the household's electricity demand from the grid network to reduce the dependence on the grid; however, that contribution was relatively small. Furthermore, the dataset indicated that no residential solar owner in Hanoi had sold solar power production to the grid. This implies the solar power production has been topped-up to the solar owner's total demand and was not conducive to reducing the carbon footprint of the power generation industry.

4. Dynamics of the rebound effect

4.1. Modelling the dynamics

The preceding estimations revealed a notable surge in a household's overall energy consumption subsequent to the installation of solar panels, coupled with a slight reduction in grid demand compared to non-solar homes. This observed phenomenon may be indicative of a rebound effect, wherein behavioral responses lead to increased consumption following the adoption of a more economical energy source. Conversely, it could stem from a natural uptick in usage when individuals have an

additional energy source to meet previously constrained demand. Furthermore, there is a plausible suggestion that these effects are dynamic, contributing to short-term spikes in household consumption that may not necessarily represent long-term adaptations. To address and scrutinize these concerns, we adapt our model in Eq. (1) as follows:

$$y_{it}^E = \alpha_i^E + \theta^E y_{it-1}^E + \lambda_t^E + \delta_k^E D_{it-k} + \mathbf{x}_{it}' \beta^E + \epsilon_{it}^E \quad \text{where } k = 0, \dots, 12. \quad (2)$$

The difference between models in Eq. (2) to the models in Eq. (1) is the existence of twelve lagged treatment dummies, D_{it-k} where $k = 0, 1, \dots, 12$. In more detail, thirteen estimations of parameter $\delta_k^{E=1}$, i.e., $\delta_0^1, \delta_1^1, \dots, \delta_{12}^1$, reflect the impact of solar adaptation on the total electricity demand immediately after installation and in the next twelve months. Similarly, thirteen estimations of parameter $\delta_k^{E=2}$, i.e., $\delta_0^2, \delta_1^2, \dots, \delta_{12}^2$, reflect the difference in the impact of solar adaptation on the grid power demand of rooftop solar owners in the same period. Estimations of parameters $\delta_k^{E=1}$ and $\delta_k^{E=2}$, then had been plotted in Fig. 1 (a1) and (b1), respectively. Besides, Fig. 1 (a2) and (b2) demonstrated $\delta_k^{E=1}$ and $\delta_k^{E=2}$ when exogenous factors were excluded in Eq. (2) estimations as a robustness check.

The dynamic of coefficients $\delta_k^{E=1}$ in Fig. 1 (a1) suggests that the impact of solar installation was remarkable in the first two periods, which caused total power demand to increase by approximately 16.5 % higher than in non-solar households. However, that difference diminished and reached about 3.5 % after thirteen months. Meanwhile, Fig. 1 (b1) displayed an opposite dynamics pattern of coefficients $\delta_k^{E=2}$. It showed that installing rooftop solar energy helped households reduce the grid energy demand by approximately 4 % in the first two months compared to homes without solar power. Nonetheless, this gap also faded out and reached approximately 1.5 % after thirteen months.

4.2. Dynamic effects

Three implications emerge from the dynamic impacts of solar installation on electricity consumption. Firstly, the diminishing trends observed in the gaps between total electricity consumption and grid power demand suggest that the associated demand shocks are transient and expected to dissipate over the long term. Consequently, it is reasonable to assert that the increase in total consumption was not instigated by restrained demand. If it were, we would anticipate an expanding demand gap after solar installation, which remains stable in the long term. Given Vietnam's 100 % electrification, the absence of severe power shortages, and the relative affluence of households in Hanoi, who can afford ample energy, the dynamic points to a significant short-term rebound effect experienced by rooftop solar prosumers upon acquiring a cost-effective energy source, namely solar energy.

Secondly, a discernible trend indicates the reduction of gaps in both total electricity consumption and grid demand between rooftop solar users and non-solar households over a thirteen-month period. This phenomenon suggests a gradual diminishment in the disparity of electricity usage behavior between the two household groups. It is plausible that these households were initially committed to altering their usage patterns of electrical appliances to maximize the utilization of solar energy. However, considering that a substantial portion of power consumption, particularly for essential activities such as cooking, studying, and entertaining, predominantly occurs during nighttime when solar energy is unavailable, these solar energy consumers may gradually revert to their established dependency on the grid, potentially leading to a reduced reliance on solar energy.⁴

Third, the reversion to previous consumption patterns may partially explain the dynamics of the rebound effect; however, it raises lingering questions regarding the decrease in solar energy consumption among

⁴ This phenomenon could be seen more obviously in the analysis of solar production in Section 6.

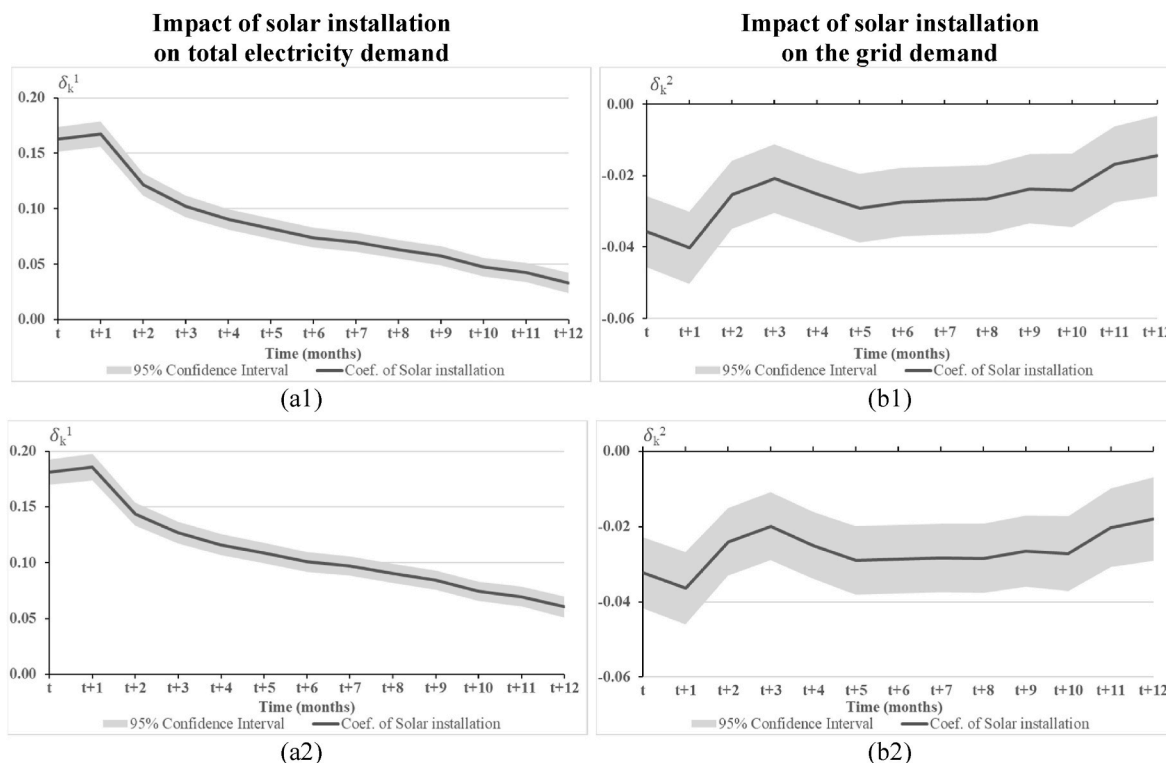


Fig. 1. Dynamics of rooftop solar installation’s rebound effects

Notes:

The figures (a1) and (a2) illustrate solar adaptation’s impact on the total electricity consumption in 13 months compared to non-solar households.

- The figures (b1) and (b2) illustrate the difference in solar adaptation’s impact on the grid power demand between rooftop solar owners and non-solar consumers in 13 months.

- The difference between models in figures (a1) versus (a2) and figures (b1) versus (b2) is the inclusion or exclusion of exogenous variables, respectively. And the purposes of figures (a2) and (b2) are to double-check the consistency of figures (a1) and (b1).

solar energy owners, who refrained from selling excess outputs to the grid.⁵ This phenomenon can be attributed to factual inadequacies in technology application and policy implementation, exemplified by the minimal adoption of solar batteries among residential consumers in Hanoi. Consequently, households installing solar panels faced a ‘take it or leave it’ scenario, unable to store surplus solar energy for nighttime use when power-intensive activities predominantly occur. Thus, those households were unable to mitigate their dependence on the grid, although they were determined to lean toward solar energy. In addition, the Vietnamese Government applies a feed-in-tariff policy to encourage households to sell unused solar power to the grid. However, the feed-in tariff, which is 8.38 cents/kWh,⁶ is lower than most tiers’ marginal prices in the retail electricity price.⁷ Meanwhile, households need to complete a tax registration procedure to be able to sell solar energy to the grid. Therefore, solar energy consumers may not have enough incentive to sell their solar production.

⁵ This is observed from the declined trends of the gaps in both total electricity demand and grid electricity demand between solar energy consumers and non-solar households.

⁶ Decision no 13/2020/QĐ-TTĐ issued on 06/04/2020 about the mechanism to encourage the development of solar power in Vietnam.

⁷ The residential electricity retail price is following six tiers: Tier 1 (0–50 kWh): 7.24 UScent/kWh- Tier 2 (51–100 kWh): 7.48 UScent/kWh- Tier 3 (101–200 kWh): 8.69 UScent/kWh- Tier 4 (201–300 kWh): 10.94 UScent/kWh- Tier 5 (301–400 kWh): 12.22 UScent/kWh- Tier 6 (>400 kWh): 12.62 UScent/kWh. The feed-in tariff of rooftop solar (8.38 cents/kWh) is only higher than tier 1 and tier 2 marginal prices.

5. Discussion on installed capacity and production

Our results above do not actively address differences in installed capacity and production that will vary across households. In this section, we explore these variables and search for their potential to explain the rebound effect analysed earlier.

We demonstrate the installed capacity distribution trend of household rooftop solar in Hanoi in Fig. 2. While most households selected a capacity smaller than 10 kW-peak (kWp) and mainly in the range of 3–7 kWp in 2019, adopters in 2020 chose a higher range of 5–10 kWp or even more than 15kWp. This could be a response to a dramatic reduction of 58 % in terms of the levelized cost of solar PV during the period 2016–2020 in Vietnam [34]. However, it is plausible that households are over-capitalising on solar investment and are creating excess supply, which may be linked to the behavioural responses hypothesised above. The potential solar energy production in Hanoi is about 3.3 kWh/kWp per day or approximately 100 kWh/kWp/month [35,36]. Based on that, the installed capacities required to fulfil the total electricity demand for households are approximately 1 kWp, 2 kWp, 3 kWp, and 4 kWp, respectively, for the households with consumption in Tier 2, Tier 3, Tier 4, and Tier 5. Thus, the illustration in Fig. 3 implies that the majority of solar energy owners in Hanoi have oversized installations.

Oversized installation could bring some potential benefits that include revenue from selling solar energy or independence on the grid for the owners, as well as reducing the peak load for the national system. However, those benefits were ambiguous or nonexistent in our study. Previously we found that the dependence on the grid was reduced by only approximately 4 %, while the whole solar energy output was added up to the owner demand. In addition, residential solar energy owners have zero revenue from selling the output based on our data in this

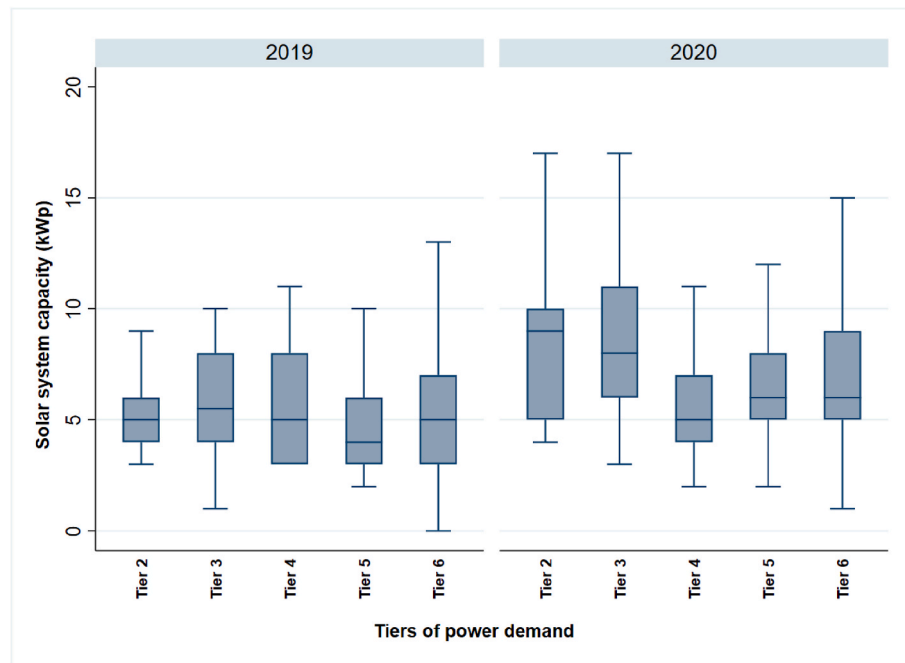


Fig. 2. Distribution of installed capacity of the household solar systems in Hanoi

Notes:

Fig. 2 demonstrates the distribution of installed capacity of the household solar systems by tiers of electricity consumption. The data are from two years, 2019 and 2020, which recorded the installation of most households in Hanoi

- Each boxplot displays the median, lower and upper quartiles of the capacity. The upper and under adjacent values are respectively determined by the formulas: $Q3 + 1.5 \times \text{Interquartile range}$ and $Q1 - 1.5 \times \text{Interquartile range}$. Outliers are not presented in this figure.

- The consumption range in each tier of power demand is explained in footnote 3 of this study.

- In this figure, a household will be assigned to a specific tier based on its highest monthly consumption before installing solar energy.

study, collected up to November 2021. Thus, installation of residential rooftop solar in Hanoi seems inefficient, resulting in higher total costs for the owners.

We illustrate the self-consumption of residential rooftop solar power in Hanoi, organized by installed capacity across four distinct seasons, using scatter plots in Fig. 3. Additionally, we compare this data with the potential output calculated from a trial installation project conducted by Thanh et al. [36], represented by the red lines. The findings from Fig. 4 suggest that only a limited number of households utilized their solar power output to its full potential, matching the capacity of their installed solar PV systems. Conversely, a significant proportion of homes consistently consumed considerably less solar power than their systems could practically generate, irrespective of the season or installed capacity. Notably, the absence of records indicating households selling solar power to the grid implies that a substantial amount of the produced solar power has gone unused or been wasted.

One plausible reason for this inefficiency is insufficient power storage due to inadequate evaluation. The most common mistake solar owners had was relying on cost-benefit analysis only but overlooking the technical analysis, which is also seen in many studies or policy recommendations. For example, Thanh et al. [36] considered that a 3kWp solar system without storage is about 45% cheaper and has only almost half the payback period of the same system but with power storage. However, this result could be different if the fact that most residential power-consumed activities occur at night is counted. Then, if a solar owner does not sell solar output to the grid, the output can only be minimally consumed by certain frequently plugged-in appliances such as refrigerators. Without the storage, cost-benefit analysis may be misleading.

Another possible reason for the inefficiency of residential solar energy in Hanoi is the lack of incentives in promoting policies. As discussed above, the feed-in tariff regulated by the Government is only 8.38 cents/

kWh, lower than most tiers' marginal prices, while the procedure to apply to sell solar output has many red tapes. As a result, solar owners would rather waste their solar power than sell it back to system. A higher feed-in tariff, which is encouraging enough to motivate solar energy owners to produce and sell, is needed. However, what threshold is appropriate requires further study as there are evidence that high feed-in tariffs cause rebound effects to be more severe [28,29].

6. Models diagnostics

6.1. Parallel trend assumption

We first examine the electricity demand trends of two groups, solar owners and non-solar households. Specifically, we aim to verify the parallel trend assumption that the difference between the demands of two groups in the absence of solar installation is constant over time. Fig. 4 demonstrates the results for the total electricity demand (Fig. 4-a) and the network electricity demand (Fig. 4-b). It is noteworthy that the parallel lines are not required to be linear, depending on the nature of the data [37]. In this case, demand lines reflect the well-known seasonality of electricity consumption. In addition, there is no apparent time boundary between before and after installation, and the lines depicting solar owners in two periods overlap in Fig. 4. This is because households installed rooftop solar systems at different points, so each solar PV owner moved from the pre-treatment sub-group to the post-treatment sub-group at various times.

As illustrated in Fig. 4-a and 4-b, households without solar power installations exhibit similar electricity usage patterns. Upon the installation of rooftop solar systems, distinct shifts in the trend lines for total electricity demand and grid power demand become evident among solar power users. For instance, in Fig. 4-a, the green dashed line representing the total electricity demand of solar power users experiences a notable

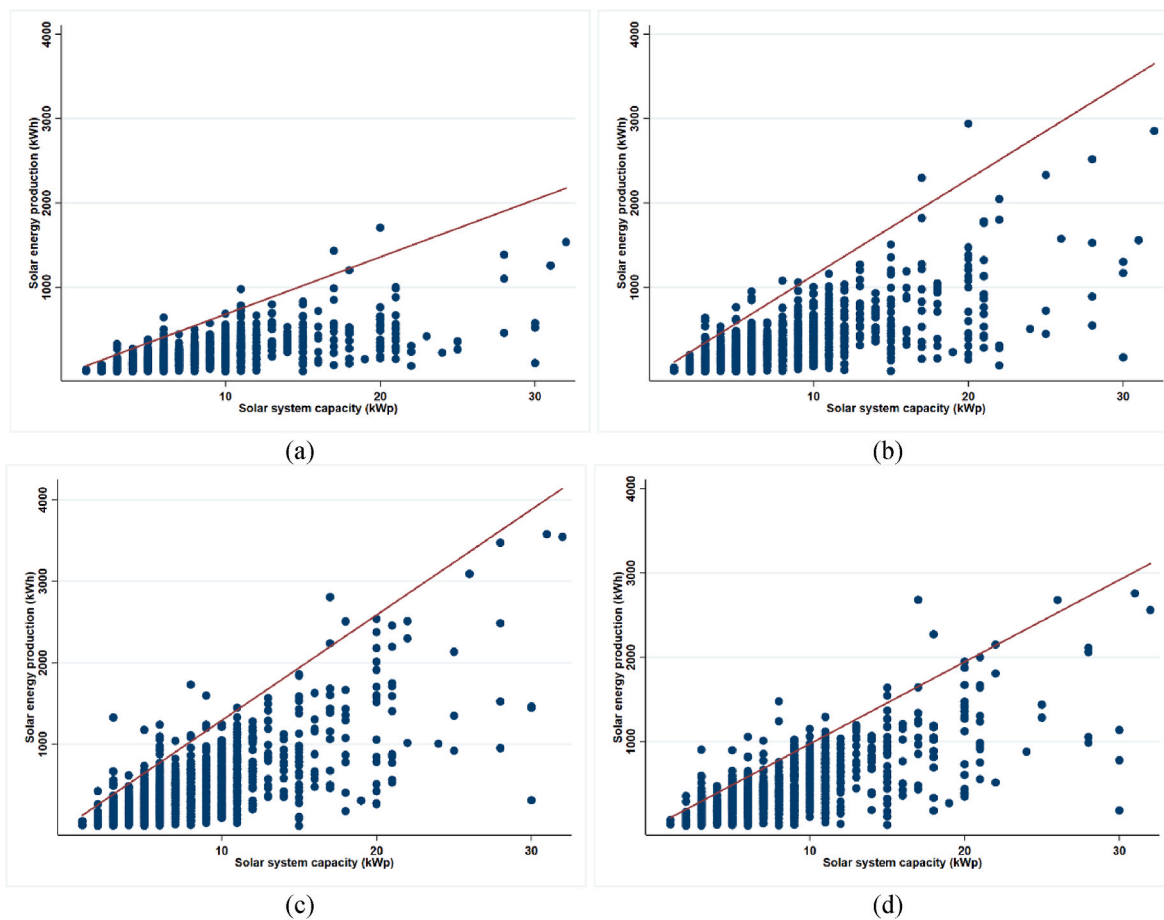


Fig. 3. Solar production consumed by households vs. potential output in four seasons

Notes:
 Fig. 3 demonstrates the solar energy production consumed by households in our data versus the potential output of Thanh et al. [36] by solar energy capacities and four seasons.

- The actual solar energy production is depicted by the dots, and the potential output is depicted by the red lines
- Figures (a), (b), (c), and (d) respectively present four seasons, Spring, Summer, Autumn, and Winter.
- We only record solar power output data from the 4th month after installation to ensure that the data are not recorded too low in the first few months of operation.

increase, setting it apart from other households, particularly from mid-2018 onward. This divergence persists throughout the observed period. Conversely, the grid demand trend line for solar power users, as depicted in Fig. 4-b, initially exhibits a considerable decrease compared to other households but gradually converges with the original trend line over time. These visual trends serve as graphical evidence supporting the previously discussed rebound effect and its dynamic nature.

6.2. Stability analysis

Table 2 provides a comparison between our models of interest with all available covariates and the simplest models with only treatment variables, i.e. D_{it} . The results imply that the full models are reliable because the coefficients of interest, δ^E , are marginally affected when more covariates are added to the models. However, we caution that potentially poor measures of underlying cofounders could cause adding these variables to be meaningless or, more seriously, lead the estimation to problematic compositional changes. This can happen if the change in D_{it} is associated with changes in other explanatory variables, i.e., the solar installation is affected by some other factors included in the model.

To examine this validity aspect of our models, we apply the process suggested by Pei et al. [38] to conduct balancing tests when putting covariates, x_{it} , on the left-hand side (LHS). Pei et al. [38] argued that this strategy is more powerful than a conventional regression of D_{it} on other

covariates, especially when the controls are bad measured. The LHS regressions are expressed by fixed-effects estimations in Eq (4):

$$x_{it} = \alpha_i^{LHS} + \lambda_t^{LHS} + \pi D_{it} + u_{it}, \tag{4}$$

where, α_i^{LHS} are time-invariant fixed effects; λ_t^{LHS} are time fixed-effects. In addition, coefficient vectors π should be statistically equal to zero to verify the validity of our base models. The balancing tests against the null hypothesis that π equals zero are presented in Table 3. The results show that both individual and joint balancing tests cannot reject the null hypothesis at any significant level below 10 % so that all controls are statistically balanced. This suggests that the difference between solar energy owners and non-solar households is stable over time, and the causal impact of solar energy installation on demand is not associated with changes in the distribution of other factors.

7. Conclusion

This paper has studied the behaviour of household energy consumption in Vietnam before and after the installation of household solar panels. Using a difference in differences approach, we have shown that upon installation, households tend to sharply increase their energy consumption, with relatively little substitution occurring from grid electricity to solar energy. As a consequence, the scope for solar panels to reduce carbon-intensive energy usage appears partially compromised,

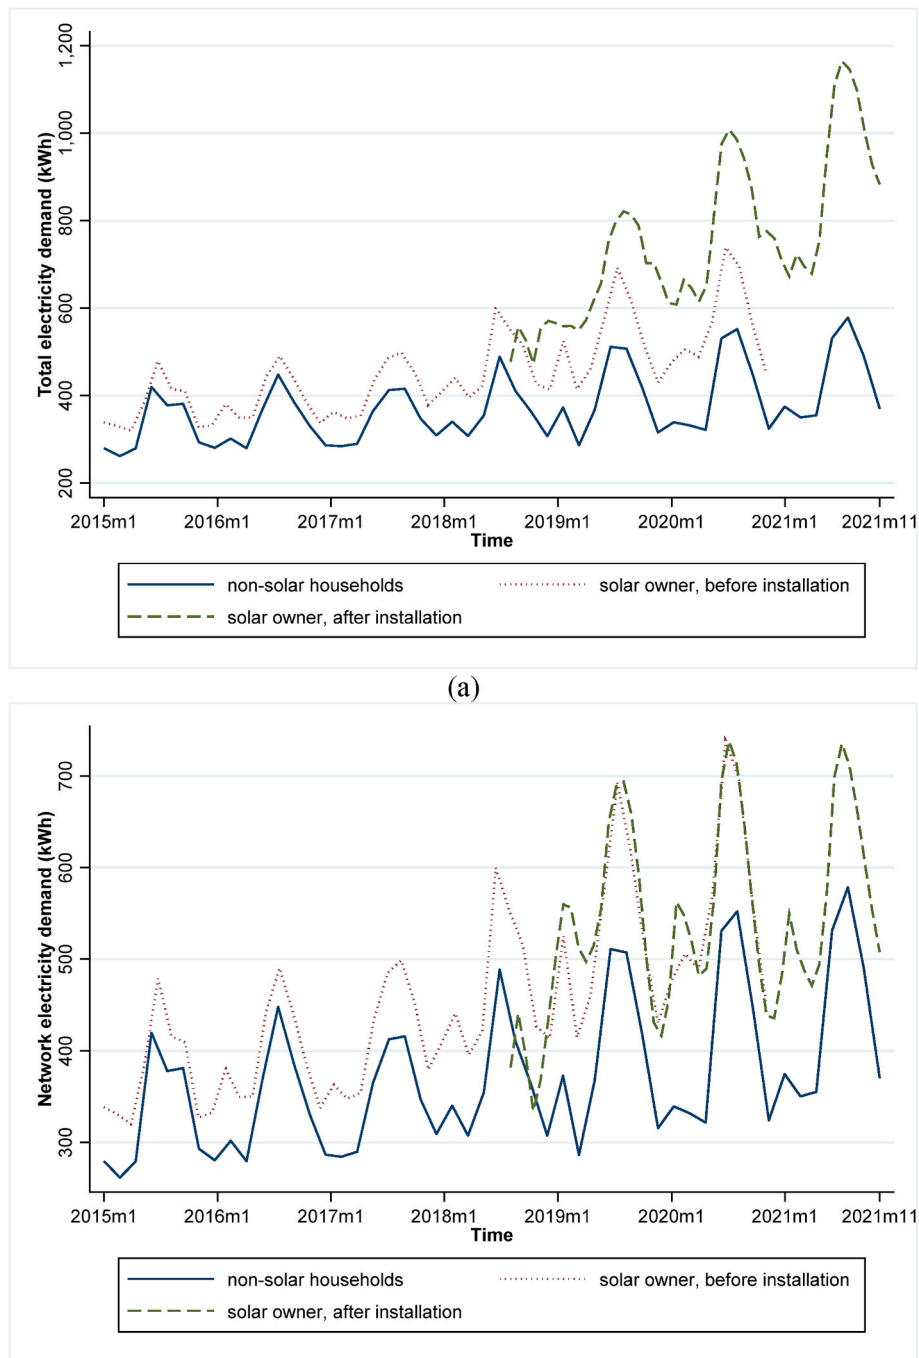


Fig. 4. Dynamics of rooftop solar installation’s rebound effects

Notes:

Fig. 4 (a) illustrate the movement trends of total electricity demand, and Fig. 4 (b) depict the movement trends of network electricity demand.

- The lines depicting solar owners in two periods, before and after installation, overlap because households have different points installing solar PV systems.

- Demands are calculated based on the average monthly consumption of all households in each group

- Total electricity demands are identical to the network electricity demand for non-solar households and yet-to-be-installed solar owners. However, the two demands are different in the case of solar owners since the solar PV is installed.

at least for developing countries like Vietnam.

Furthermore, our findings indicate that the solar energy rebound effect manifested prominently in the short term but gradually diminished over time. To be specific, the total electricity demand of households with solar installations surged significantly by 16 % following the installation of solar systems, gradually tapering to approximately 3.5 % after a twelve-month period. While this decline might be viewed as a positive trend, it is indicative of a slow abandonment of solar energy

over time, with potential adverse implications for both household welfare and carbon pollution. We contend that fostering improved energy battery adoption and implementing more incentivizing policies could contribute to mitigating this issue.

Since households that install solar panels may possess unobserved characteristics that distinguish them from households that did not, there is the potential for our results to be affected by unobserved confounding. However, across a range of diagnostic methods, we find little evidence

Table 3
Balancing tests the associations between D_{it} and x_{it} .

	<i>p</i> -values of π
LHS balancing test:	
Individual:	
Average electricity price (log)	0.107
Urbanisation rate (%)	0.764
Average electricity price (log)* Urbanisation rate	0.442
Income (log)	0.151
Squared income (log)	0.144
Number of families	0.296
Employment rate	0.643
Rate of household having more than 3 kids	0.646
Joint:	0.5955

Notes: Table 4 expresses the result of the left-hand side (LHS) balancing test suggested by Pei et al. [38]- The LHS balancing test is estimated based on the first different estimator of equations $x_{it} = \alpha_i^{LHS} + \lambda_i^{LHS} + \pi D_{it} + u_{it}$. The joint LHS balancing test is implemented by the *suest* command in Stata.

that endogeneity or misspecification issues may be biasing our results. As estimates need to be causal in order to meaningfully inform policy, the stability of our results is a major advantage.

Nevertheless, our study is subject to certain limitations. Firstly, detailed demographic and financial data at the household level were not within the scope of our data collection. Additionally, the available data lack granularity in terms of electrical appliance usage, which would have provided a more nuanced analysis of how rooftop solar owners adjust their consumption post-installation. Despite our efforts to conduct surveys in Hanoi for the collection of such data, all attempts were regrettably cancelled due to the Covid-19 epidemic. These limitations, acknowledged herein, underscore the need for future research

Appendix

Placebo regression

Estimates of solar energy installation on electricity demands, measured by δ^E in Eq. (1), could be invalid if the model is incorrectly specified. One way to diagnose potential specification errors is to run a *placebo regression*, where the treatment is shifted into a period where no effect is expected to occur. If our model produces significant results in these placebo specifications, it suggests that some other factor may account for the results. To examine that effect, we apply a Granger-type causality framework [39] to Eq (1) by including three (03) leading values of the dummy variable D_{it} , which are D_{it+f} with $f = [1, 3]$. The test equations can be expressed as follows,

$$y_{it}^E = \alpha_i^E + \theta^E y_{it-1}^E + \lambda_i^E + \delta^E D_{it} + \sum_{f=1}^3 \delta_f^E D_{it+f} + x_{it}' \beta^E + e_{it}^E \quad (3)$$

The estimation outputs provided in Table 4 suggest that all leading values D_{it+f} are insignificant. The Wald test further verified that three values of D_{it+f} (with $f = 1, 2, 3$) jointly equal zero. Therefore, we can reject the null hypothesis that the solar energy installation is anticipated by outcomes measured in earlier periods, considering up to three periods.

Table 4
Granger causality tests for the placebo effect

	(1)	(3)
Solar installation (treatment)	0.164*** (0.010)	-0.046*** (0.009)
Solar installation (1-period lead, δ_1^E)	-0.005 (0.012)	-0.004 (0.012)
Solar installation (2-periods lead, δ_2^E)	-0.010 (0.012)	-0.009 (0.012)
Solar installation (3-periods lead, δ_3^E)	0.002 (0.009)	0.011 (0.009)
Log of total electricity demand (lagged)	0.670*** (0.005)	
Log of grid electricity demand (lagged)		0.676*** (0.006)
Average electricity price (log)	-0.137***	0.042***

(continued on next page)

endeavors to address these aspects comprehensively.

CRedit authorship contribution statement

Luan Thanh Nguyen: Writing – review & editing, Writing – original draft, Visualization, Validation, Resources, Methodology, Investigation, Formal analysis. **Shyama Ratnasiri:** Supervision. **Liam Wagner:** Supervision. **Dan The Nguyen:** Data curation. **Nicholas Rohde:** Writing – review & editing, Supervision, Formal analysis.

Declaration of competing interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

Acknowledgements

We are grateful to Professor Soteris A. Kalogirou, PhD, DSc, Editor in Chief of Renewable Energy journal and two anonymous reviewers for their valuable support and comments.

We are grateful to the General Statistics Office of Vietnam and Hanoi Power Corporation for providing the data and intensive support. The research undertaken in this paper greatly benefited from the thoughtful comments at the Australian Conference of Economist 2022.

Luan Thanh Nguyen is grateful for the financial support of the Endeavour Leadership Program from the Australian Government. Liam Wagner is grateful for the support of the Australian Research Council (ARC, DP160102570) and the Australian Renewable Energy Agency (ARENA).

Table 4 (continued)

	(1)	(3)
Urbanisation rate (%)	0.004 (0.005)	0.011** (0.005)
Average electricity price (log)* Urbanisation rate	0.002*** (0.000)	0.000 (0.000)
Income (log)	3.731*** (0.495)	2.333*** (0.491)
Squared income (log)	-0.206*** (0.028)	-0.129*** (0.028)
Number of families	0.021*** (0.008)	0.024*** (0.009)
Employment rate	-0.001 (0.000)	-0.001** (0.000)
Rate of household having more than 3 kids	-0.0003 (0.001)	-0.001 (0.001)
Observations	195,299	195,299
R-squared	0.651	0.592
Groups	3541	3541
Average group size	55.15	55.15
Panel-level standard deviation (σ_u)	0.751	0.446
Standard deviation of ϵ_{it} (σ_e)	0.275	0.281
Adjusted R-squared	0.651	0.592
R-squared within model	0.651	0.592
R-squared overall model	0.478	0.625
R-squared between model	0.529	0.694
Wald test for $\delta_1^E = \delta_2^E = \delta_3^E = 0$		
F(3, 3540)	0.83	0.62
Prob > F	0.4798	0.6021

Notes.

- The dependent variable in Model (1) is the log of the household’s total electricity consumption.
- The dependent variable in Model (2) is the log of the household’s electricity purchased from the grid network.
- All models include households’ time-invariant fixed-effects and time-variant fixed-effects.
- Standard errors are clustered at the household level and reported in parentheses.
- ***, **, *: significant at the significant level of 1 %, 5 % and 10 %.

Magnitude of Nickell bias

There are potential concerns in our dynamic panel data model regarding the inclusive of a first-order autoregressive model in a fixed-effect model, i.e. the appearance of y_{it-1} in Eq (1) [40]. Pischke [41] and Angrist and Pischke [42] emphasised that if the model with first-order autoregressive is correct, the use of the fixed-effects model will lead to an overstated positive treatment effect, i.e. δ is too big. Conversely, the mistaken use of the first-order autoregressive model, while the fixed-effects model is correct, leads to an understated positive treatment effect, i.e. δ is too small. For this, we conduct Born and Breitung’s [43] portmanteau test for serial correlation in fixed-effects panel models to verify the inclusion of y_{it-1} in Eq (1). The result of this test is given in the Appendix.

Meanwhile, the model nest both lagged dependent variables and fixed effects could raise a downward biased if the time series (T) is short [40]. However, this issue can be neglected if T is “reasonably large”, e.g., Beck et al. [44] considered that T = 40 is sufficient. Given that T = 83, the potential bias in our models is very small and could be considered as zero following that guidance.⁸ We note that Nickell’s bias can be solved by applying the generalized method of moments (GMM). However, because the Nickell bias could be considered not significant, we only report results by regular fixed-effects regression.

Portmanteau test for serial correlation in fixed-effects panel models

Born and Breitung’s [43] portmanteau test for serial correlation in fixed-effects panel models is to test if the error term from ϵ_{it}^E from Eq (5) has serial correlation:

$$y_{it}^E = \alpha_i^E + \lambda_i^E + \delta_k^E D_{it-k} + \mathbf{x}_{it}' \beta^E + \epsilon_{it}^E \quad k = 0, \dots, 12. \tag{5}$$

$$\epsilon_{it}^E = \sigma \epsilon_{it-1}^E + e_{it}$$

where the difference of Eq (5) from Eq (2) is only the exclusion of the lagged dependent variable, y_{it-1} .

The test is stated as follows:

- H0: No auto-correlation of any order, i.e., $\sigma = 0$.
- Ha: Auto-correlation up to order 1, i.e., $\sigma \neq 0$.

⁸ According to Nickell’s [40] Monte Carlo simulation, the simple approximation of the bias in a within-group estimator is $-\frac{1+\theta}{T-1}$, where θ is parameter of lagged dependent variable y_{it-1} . Applying this approximation with $\theta = 0.69$ and $T = 83$, the bias in this study is approximately 2 %.

The result of the test (Table 5) rejects the null hypothesis and suggests the alternative that there is an auto-correlation issue. Thus, the inclusion of lagged dependent variable, y_{it-1} , is reasonable.

Table 5
Testing for serial correlation in the base models

	(1)	(2)
Solar installation (treatment)	0.475*** (0.016)	-0.049*** (0.016)
Average electricity price (log)	-0.520*** (0.051)	0.154*** (0.045)
Urbanisation rate (%)	0.023 (0.015)	0.041** (0.016)
Average electricity price (log)* Urbanisation rate	0.004*** (0.001)	-0.001 (0.001)
Income (log)	9.129*** (1.479)	7.225*** (1.534)
Squared income (log)	-0.507*** (0.083)	-0.402*** (0.087)
Number of families	0.081*** (0.023)	0.088*** (0.025)
Employment rate	-0.003** (0.001)	-0.003** (0.002)
Rate of household having more than 3 kids	-0.0002 (0.004)	0.00004 (0.004)
Observations	232,756	232,756
R-squared	0.312	0.171
Groups	3544	3544
Average group size	65.68	65.68
Panel-level standard deviation (σ_u)	2.040	1.383
Standard deviation of ϵ_{it} (σ_e)	0.421	0.436
Adjusted R-squared	0.312	0.170
Inoue and Solon [45] LM-test as post estimation		
IS-stat	1559.61	1387.41
p-value	0.000	0.000
N	3544	3544
maxT	82	82

Notes.

- The dependent variable in Model (1) is the log of the household’s total electricity consumption.
- The dependent variable in Model (2) is the log of the household’s electricity purchased from the grid network.
- All models include households’ time-invariant fixed-effects and time-variant fixed-effects. The difference between these estimations and the ones in Table 2 is the exclusion of lagged dependent variable, y_{it-1} .
- The test for panel serial autocorrelation used Born and Breitung [43] implementation, initially described by Inoue and Solon [45]. This test can be conducted by *xttest* command in Stata, implemented by Wursten [46].
- ***, **, *: significant at the significant level of 1 %, 5 %, and 10 %.
- Robust standard errors are reported in parentheses.

Estimations based on solar capacity explanatory variable

An alternative method for assessing the rebound effect of installing rooftop solar power involves utilizing installed capacity as an explanatory variable, in contrast to employing a dummy variable that signifies the periods before and after installation. This approach presents the advantage of capturing various levels of rebound effect, with higher capacity often associated with more pronounced rebound effects. However, it is crucial to acknowledge the potential correlation between capacity and household wealth, an additional explanatory variable for electricity demand. Consequently, the impact of solar capacity on electricity consumption and the rebound effect may be subject to bias due to multicollinearity.

Nevertheless, for comprehensive consideration, we introduce the estimation results of this alternative approach in Table 6 as a reference.

Table 6
Estimates output of baseline models based on installed solar capacity

	(1)	(2)	(3)	(4)
Installed solar capacity	0.021*** (0.001)	0.023*** (0.001)	-0.004*** (0.001)	-0.003*** (0.001)
Log of total electricity demand (lagged)	0.690*** (0.005)	0.697*** (0.005)		
Log of grid electricity demand (lagged)			0.701*** (0.005)	0.702*** (0.005)
Average electricity price (log)	-0.164*** (0.014)		0.033** (0.014)	
Urbanisation rate (%)	0.006 (0.005)		0.010* (0.005)	

(continued on next page)

Table 6 (continued)

	(1)	(2)	(3)	(4)
Average electricity price (log)* Urbanisation rate	0.002*** (0.000)		0.000 (0.000)	
Income (log)	3.361*** (0.477)		2.289*** (0.468)	
Squared income (log)	-0.186*** (0.027)		-0.128*** (0.026)	
Number of families	0.017** (0.007)		0.019** (0.008)	
Employment rate	-0.001** (0.000)		-0.001** (0.000)	
Rate of household having more than 3 kids	0.000 (0.001)		-0.000 (0.001)	
Observations	223,562	223,562	223,562	223,562
R-squared	0.660	0.659	0.594	0.594
Groups	3544	3544	3544	3544
Average group size	63.08	63.08	63.08	63.08
Panel-level standard deviation (σ_u)	0.747	0.190	0.422	0.218
Standard deviation of ϵ_{it} (σ_e)	0.286	0.287	0.295	0.295
Adjusted R-squared	0.660	0.659	0.594	0.594
R-squared within model	0.660	0.659	0.594	0.594
R-squared overall model	0.498	0.852	0.650	0.841
R-squared between model	0.553	0.989	0.724	0.997

Notes.

- The dependent variables in models (1) and (2) are the household's total electricity consumption (in log form).
- The dependent variables in models (3) and (4) are the household's grid electricity demand (in log form).
- Installed solar capacity is zero for household does not have or have not installed rooftop solar.
- All models include households' time-invariant fixed-effects and time-variant fixed-effects.
- Standard errors are clustered at the household level and reported in parentheses.
- ***, **, *: significant at the significant level of 1 %, 5 % and 10 %.

References

- [1] D.J. Arent, A. Wise, R. Gelman, The status and prospects of renewable energy for combating global warming, *Energy Econ.* 33 (2011) 584–593, <https://doi.org/10.1016/j.eneco.2010.11.003>.
- [2] O.I. Asensio, M.A. Delmas, Nonprice incentives and energy conservation, *Proc. Natl. Acad. Sci. U.S.A.* 112 (2015) E510, <https://doi.org/10.1073/PNAS.1401880112>. –E515.
- [3] L. Steg, G. Perlaviciute, E. van der Werff, Understanding the human dimensions of a sustainable energy transition, *Front. Psychol.* 6 (2015), <https://doi.org/10.3389/fpsyg.2015.00805>.
- [4] E. Van der Werff, L. Steg, K. Keizer, It is a moral issue: the relationship between environmental self-identity, obligation-based intrinsic motivation and pro-environmental behaviour, *Global Environ. Change* 23 (2013) 1258–1265, <https://doi.org/10.1016/j.gloenvcha.2013.07.018>.
- [5] B. Bollinger, K. Gillingham, A.J. Kirkpatrick, S. Sexton, Visibility and peer influence in durable good adoption, *Market. Sci.* 41 (2022) 453–476.
- [6] B. Bollinger, K. Gillingham, Peer effects in the diffusion of solar photovoltaic panels, *Market. Sci.* 31 (2012) 900–912.
- [7] W. Abrahamse, L. Steg, C. Vlek, T. Rothengatter, A review of intervention studies aimed at household energy conservation, *J. Environ. Psychol.* 25 (2005) 273–291, <https://doi.org/10.1016/j.jenvp.2005.08.002>.
- [8] W. Abrahamse, L. Steg, Social influence approaches to encourage resource conservation: a meta-analysis, *Global Environ. Change* 23 (2013) 1773–1785, <https://doi.org/10.1016/j.gloenvcha.2013.07.029>.
- [9] M. Harding, D. Rapson, Does absolutism promote sin? A conservationist's dilemma, *Environ. Resour. Econ.* 73 (2019) 923–955.
- [10] N. Mazar, C.-B. Zhong, Do green products make us better people? *Psychol. Sci.* 21 (2010) 494–498.
- [11] Matthew E. Oliver, Juan Moreno-Cruz, Kenneth Gillingham, Microeconomics of the solar rebound under net metering, April 11, USAEE (2023), <https://doi.org/10.2139/ssrn.4416747>. Working Paper No. 23-588, Available at: SSRN: <https://ssrn.com/abstract=4416747>.
- [12] W.S. Jevons, *The Coal Question*, Macmillan Publishers - Macmillan & Co., London, 1865.
- [13] J.D. Khazoom, Economic implications of mandated efficiency in standards for household appliances, *Energy J.* 1 (1980) 21–40.
- [14] K. Du, S. Shao, Z. Yan, Urban residential energy demand and rebound effect in China: a stochastic energy demand frontier approach, *Energy J.* 42 (2021).
- [15] T. Wei, Y. Liu, Estimation of global rebound effect caused by energy efficiency improvement, *Energy Econ.* 66 (2017) 27–34, <https://doi.org/10.1016/j.eneco.2017.05.030>.
- [16] J. Zhang, C.Y.C. Lin Lawell, The macroeconomic rebound effect in China, *Energy Econ.* 67 (2017) 202–212, <https://doi.org/10.1016/j.eneco.2017.08.020>.
- [17] K. Turner, "Rebound" effects from increased energy efficiency: a time to pause and reflect, *Energy J.* 34 (2013).
- [18] J. Freire González, Empirical evidence of direct rebound effect in Catalonia, *Energy Pol.* 38 (2010) 2309–2314, <https://doi.org/10.1016/j.enpol.2009.12.018>.
- [19] K. Mizobuchi, An empirical study on the rebound effect considering capital costs, *Energy Econ.* 30 (2008) 2486–2516, <https://doi.org/10.1016/j.eneco.2008.01.001>.
- [20] M. Frondel, J.J. Peters, C. Vance, J. Org Peters, Identifying the rebound: evidence from a German household panel, *Energy J.* 29 (2008) 145–163.
- [21] J. Dimitropoulos, Energy productivity improvements and the rebound effect: an overview of the state of knowledge, *Energy Pol.* 35 (2007) 6354–6363, <https://doi.org/10.1016/j.enpol.2007.07.028>.
- [22] J. Bentzen, Estimating the rebound effect in US manufacturing energy consumption, *Energy Econ.* 26 (2004) 123–134, [https://doi.org/10.1016/S0140-9883\(03\)00047-1](https://doi.org/10.1016/S0140-9883(03)00047-1).
- [23] S. Sorrell, J. Dimitropoulos, M. Sommerville, Empirical estimates of the direct rebound effect: a review, *Energy Pol.* 37 (2009) 1356–1371, <https://doi.org/10.1016/j.enpol.2008.11.026>.
- [24] L.A. Greening, D.L. Greene, C. Difiglio, Energy efficiency and consumption — the rebound effect — a survey, *Energy Pol.* 28 (2000) 389–401, [https://doi.org/10.1016/S0301-4215\(00\)00021-5](https://doi.org/10.1016/S0301-4215(00)00021-5).
- [25] R.C. Beppler, D.C. Matisoff, M.E. Oliver, Electricity consumption changes following solar adoption: testing for a solar rebound, *Econ. Inq.* 61 (2023) 58–81.
- [26] N. Boccara, A. Gautier, Solar rebound: the unintended consequences of subsidies, *Energy Econ.* 100 (2021) 105334, <https://doi.org/10.1016/j.eneco.2021.105334>.
- [27] Y. Qiu, M.E. Kahn, B. Xing, Quantifying the rebound effects of residential solar panel adoption, *J. Environ. Econ. Manag.* 96 (2019) 310–341, <https://doi.org/10.1016/j.jeeem.2019.06.003>.
- [28] K. Tanaka, C. Wilson, S. Managi, Impact of feed-in tariffs on electricity consumption, *Environ. Econ. Pol. Stud.* 24 (2022) 49–72, <https://doi.org/10.1007/S10018-021-00306-W>.
- [29] A. La Nauze, Power from the people: rooftop solar and a downward-sloping supply of electricity, *J. Assoc. Environ. Resour. Econ.* 6 (2019) 949–982, <https://doi.org/10.1086/705535>.
- [30] G. Deng, P. Newton, Assessing the impact of solar PV on domestic electricity consumption: exploring the prospect of rebound effects, *Energy Pol.* 110 (2017) 313–324, <https://doi.org/10.1016/j.enpol.2017.08.035>.
- [31] J.L. Gallup, J.D. Sachs, A.D. Mellinger, *Geography and Economic Development*, 1998, <https://doi.org/10.3386/W6849>.
- [32] J.T. Rothwell, D.S. Massey, Geographic effects on intergenerational income mobility, *Econ. Geogr.* 91 (2015) 83–106, <https://doi.org/10.1111/ECGE.12072/ABSTRACT>.
- [33] E. Rossi-Hansberg, *Geography of growth and development*, Oxford Res. Encycl. Econ. Financ (2019), <https://doi.org/10.1093/ACREFORE/9780190625979.013.273>.
- [34] H.T.T. Le, E.R. Sanseverino, D.Q. Nguyen, M.L. Di Silvestre, S. Favuzza, M. H. Pham, Critical assessment of feed-in tariffs and solar photovoltaic development

- in Vietnam, *Energies* 15 (556 15) (2022) 556, <https://doi.org/10.3390/EN15020556>, 2022.
- [35] ESMAP, *Global Photovoltaic Power Potential by Country*, 2020.
- [36] T.N. Thanh, P.V. Minh, K.D. Trung, T. Do Anh, Study on performance of rooftop solar power generation combined with battery storage at office building in northeast region, vietnam. *Sustain.* 13 (2021), <https://doi.org/10.3390/SU131911093>.
- [37] C. Wing, K. Simon, R.A. Bello-Gomez, Designing difference in difference studies: best practices for public health policy research, *Annu. Rev. Public Heal.* 39 (2018) 453–469, <https://doi.org/10.1146/ANNUREV-PUBLHEALTH-040617-013507>.
- [38] Z. Pei, J.S. Pischke, H. Schwandt, Poorly measured confounders are more useful on the left than on the right, *J. Bus. Econ. Stat.* 37 (2019) 205–216, https://doi.org/10.1080/07350015.2018.1462710/SUPPL_FILE/UBES_A_1462710_SM4818.PDF.
- [39] C.W.J. Granger, Investigating causal relations by econometric models and cross-spectral methods, *Econometrica* 37 (1969) 424, <https://doi.org/10.2307/1912791>.
- [40] S. Nickell, Biases in dynamic models with fixed effects, *Econometrica* 49 (1981) 1417, <https://doi.org/10.2307/1911408>.
- [41] J.-S. Pischke, *Empirical Methods in Applied Economics Lecture Notes*, vol. 24, 2005.
- [42] J.D. Angrist, J.-S. Pischke, *Mostly Harmless Econometrics : an Empiricist's Companion*, 2009.
- [43] B. Born, J. Breitung, Testing for serial correlation in fixed-effects panel data models, *Econom. Rev.* 35 (2016) 1290–1316, <https://doi.org/10.1080/07474938.2014.976524>.
- [44] N.L. Beck, J.N. Katz, U.G. Mignozzetti, Of Nickell bias and its cures: comment on gaibulloev, sandler, and sul, *Polit. Anal.* 22 (2014) 274–278, <https://doi.org/10.1093/PAN/MPU004>.
- [45] A. Inoue, G. Solon, A Portmanteau test for serially correlated errors in fixed effects models, *Econom. Theor.* 22 (2006) 835–851, <https://doi.org/10.1017/S0266466606060385>.
- [46] J. Wursten, Testing for serial correlation in fixed-effects panel models, *STATA J.* 18 (2018) 76–100.